


REVISIONS

Ⓐ REVISED MERV RATING, WAS 8
GAC 22MAY2020 - GC 22MAY2020 - SH 22MAY2020

AAF PART NUMBER	NOMINAL SIZE		ACTUAL SIZE		RATED AIRFLOW (CFM)	PLEATS PER LINEAL FOOT	RATED INITIAL RESISTANCE @ 300 FPM (in. W.G.)	RECOMMENDED FINAL RESISTANCE (in. W.G.)	ASHRAE 52.2 MERV	CONTINUOUS OPERATING TEMPERATURE LIMITS		FILTERS PER CARTON
	W	H	W	H						DEG F	DEG C	
148-801-200	10	20	9 1/2	19 1/2	400	14.0	0.20	1.0	9	200	93	12
148-801-303	12	12	11 1/2	11 1/2	300							
148-801-319	12	24	11 3/8	23 3/8	600							
148-801-371	14	20	13 1/2	19 1/2	600							
148-801-375	14	25	13 1/2	24 1/2	750							
148-801-400	15	20	14 1/2	19 1/2	650							
148-801-448	16	16	15 1/2	15 1/2	550							
148-801-500	16	20	15 1/2	19 1/2	650							
148-801-600	16	25	15 1/2	24 1/2	850							
148-801-635	18	24	17 3/8	23 3/8	900							
148-801-631	18	25	17 1/2	24 1/2	950							
148-801-700	20	20	19 1/2	19 1/2	850							
148-801-800	20	25	19 1/2	24 1/2	1050							
148-801-863	24	24	23 3/8	23 3/8	1200							
148-801-870	25	25	24 1/2	24 1/2	1300							

- FRAME:
HIGH WET STRENGTH BEVERAGE BOARD
- MEDIA:
100% SYNTHETIC FIBER UNIFORM MEDIA WITH CONTROLLED FIBER SIZE AND BLEND
- METAL BACKING:
HEAVY-DUTY, GALVANIZED EXPANDED METAL
- ASSEMBLY ADHESIVE:
MOISTURE-RESISTANT
- UL 900 CLASSIFIED
- TOLERANCES:
DEPTH: ±1/16"
HEIGHT AND WIDTH: ±1/8"

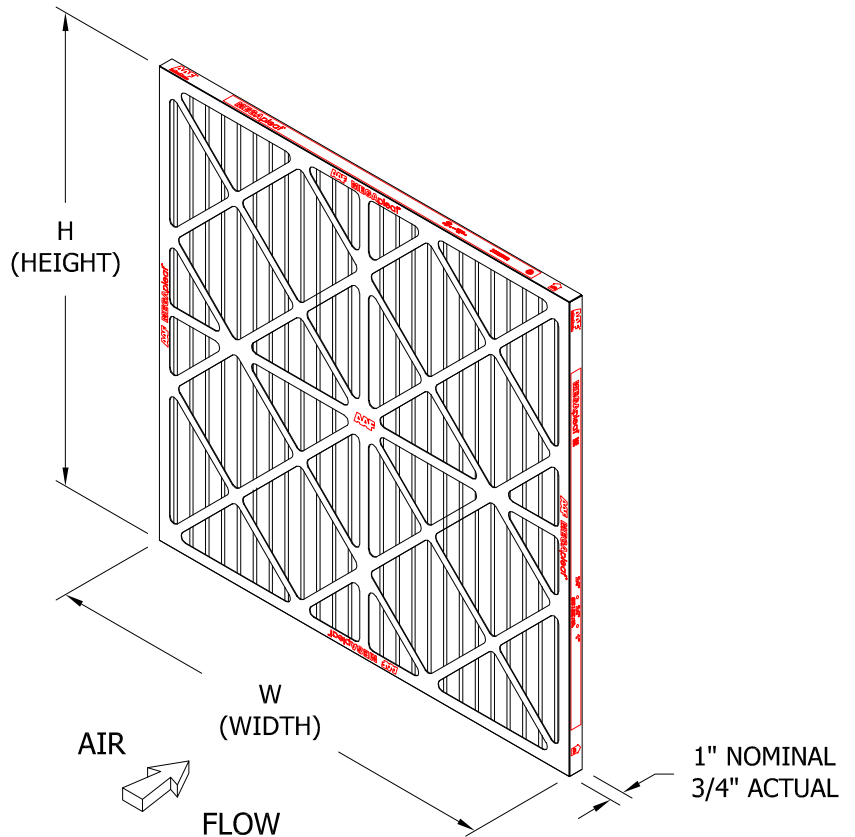

FORM I297 REV. 5/00

DRAWN GAC	DATE 24OCT12	CHECKED GC	DATE 25OCT12	APPR. RDL	DATE 25OCT12	SUPERSEDES
--------------	-----------------	---------------	-----------------	--------------	-----------------	------------



P.O. Box 35690
Louisville, KY.
40232-5690
www.aafintl.com

FILTER ASSEMBLY,
1" MEGAPleat M9

DRAWING NO.	REV
3100452	A
SHEET 1 OF 1	