

CD85

INDUSTRIAL DEHUMIDIFIER

OWNER'S MANUAL



www.eipl.co.uk

CD85

PACKAGE CONTENTS

Item	Description	Quantity
10293GR-US	Dehumidifier	1
3014338	PVC Tube – 12mm I/D	3M
3086101	Jubilee clip	1
3090150	Handle	2
TPC361	Manual	1

INTRODUCTION

Designed for a wide range of applications, the CD85 dehumidifier is a rugged, industrial unit which utilizes an energy-efficient compressor and a compact portable design to provide easy efficient drying.

The CD85 has a number of special features:

- Compact Size
- High efficiency rotary compressor
- Ebac's "**Hot Gas**" defrost system
- Exterior epoxy powder-coated finish
- Provision for permanent drainage
- All galvanized interior
- Extra long power cord
- Humidistat

The fan draws the moist air through the cold evaporator coil, which cools the air below its dew point. Moisture forms on the evaporator coil and is collected in the condensate tray, which is equipped with a permanent drain. The cooled air then passes through the hot condenser coil where it is reheated using the same energy removed during the cooling phase, plus the additional heat generated by the compressor. The air is, therefore, discharged from the dehumidifier at a slightly higher temperature with a lower absolute humidity than that which entered. Continuous circulation of air through the dehumidifier gradually reduces the relative humidity within the area.



The CD85 dehumidifier is a rugged, reliable drying unit designed to operate effectively over a broad range of temperature and humidity conditions. An active hot gas defrost system, controlled by an electronic timer, guarantees positive de-icing, thereby optimizing operation at low temperatures.


The unit incorporates a welded and galvanized steel chassis and is finished in an epoxy coating for resilience to damage caused by rough handling.

COVERS

The CD85 covers can be swapped to allow the airflow direction to be changed to better suit the application the unit is to be used for. To change the covers, first remove the 4 off retaining screws and washers from each cover, swap cover positions and replace 4 off retaining screws and washers. If changing the evaporator covers then the filter retaining mesh should always be placed behind the Evaporator Grille Cover. This is held in place with 4 off M3 hex head bolts.

Evaporator Grille Cover and Evaporator Blanking Cover are interchangeable.
 Condenser Grille Cover and Condenser Blanking Cover are interchangeable.
 Evaporator and Condenser covers are not interchangeable.
 The different combinations available are shown below.

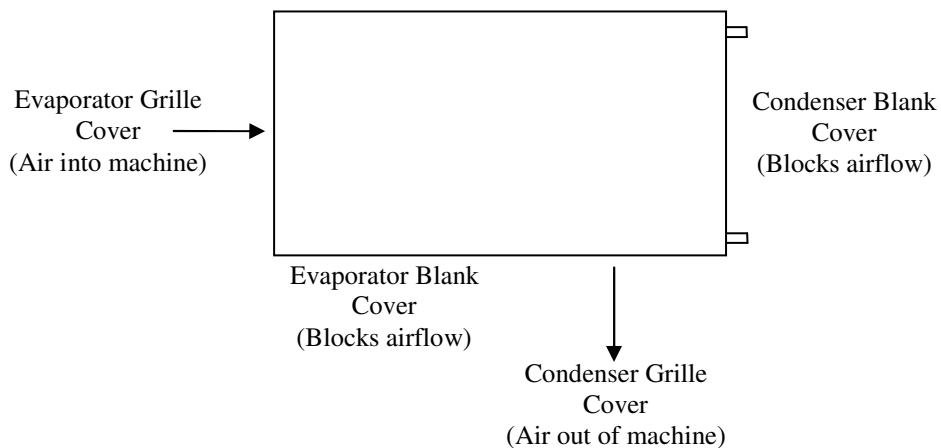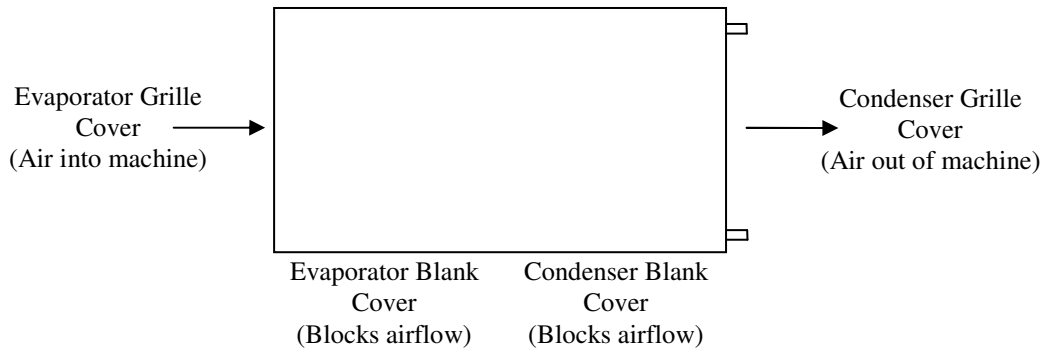

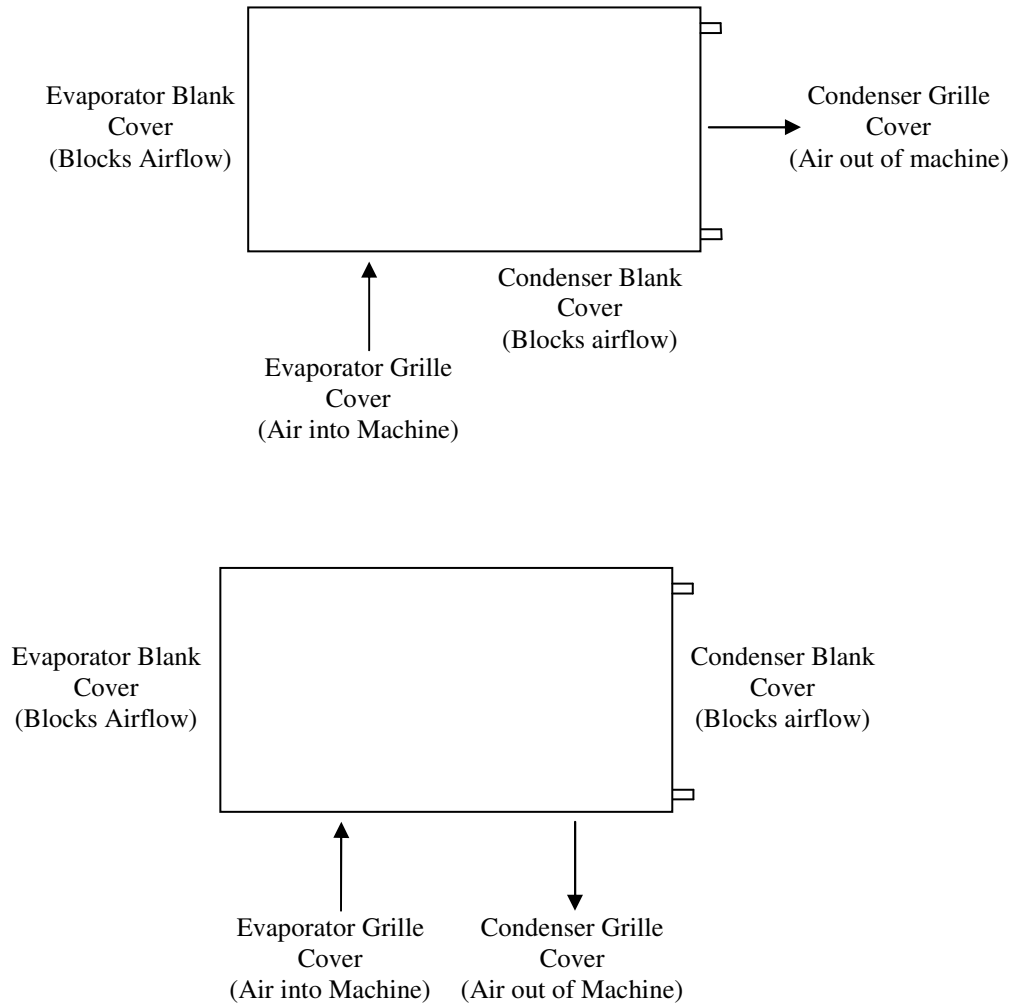

HANDLE

The CD85 can be fitted with handles if required. Handles are found separate in the packaging. On top of the unit there are 4 off M5 pan headed bolts. Remove the bolts with appropriate flat bladed screw driver. Place handles over fixings on top of unit and replace M5 bolts to secure handle.

SPECIFICATIONS

MODEL: CD85

HEIGHT: 15.75"

WIDTH: 23.6"

DEPTH: 13.5"

WEIGHT: 75 lbs

AIRFLOW: 360 CFM

EXTRACTION: 56 Pints Per Day

POWER SUPPLY: 110V/ 60Hz/ 1 ph

FINISH: Powder-coated Epoxy

OPERATING RANGE: 33°F – 95°F

REFRIGERANT: R-407c (17.64 oz)

"This product contains fluorinated greenhouse gases covered by the Kyoto Protocol. The refrigeration system is hermetically sealed.

The Global Warming Potential (GWP) of refrigerants used in products manufactured by Ebac Industrial Products Ltd is as follows

R134a – 1300

R407c – 1610

For type and weight of refrigerant contained in this unit, please refer to the product data label"

OPERATION

The following procedures should be followed to test the CD85 for correct operation:

1. After unpacking, examine all external features to confirm damage-free shipment. Report all defects and damage at once. Connect the power cable to a grounded 15 Amp electrical outlet.
2. Check dehumidification process as follows:

TO ENSURE CONTINUED FULL EFFICIENCY OF THE DEHUMIDIFIER, MAINTENANCE PROCEDURES SHOULD BE PERFORMED AS FOLLOWS:

- A. Place unit on a level surface.
- B. Start up unit by turning the humidistat control knob until the unit turns on.
- C. Check that the compressor is running.
- D. Leave the machine running for 15 minutes.
- E. Observe the evaporator coils through the evaporator filter panel
 - i. If the air temperature is below 80° F, an even coating of frost should cover the entire evaporator coil
 - ii. If the air temperature is above 80° F, frost and/or droplets of condensed water should cover the entire evaporator coil.
- F. When the unit is operated in ambient of less than 59°F, a defrost cycle should occur approximately every hour. The exact time is impossible to predict as the unit is fitted with a temperature sensitive defrost control.

If, after carrying out the above procedures, the unit does not appear to function properly, refer to the *Trouble Shooting* section, which follows, or contact the Factory Service Center.

<p>CAUTION: ONCE THE UNIT HAS BEEN SWITCHED OFF, WAIT AT LEAST FIVE MINUTES BEFORE RESTARTING.</p>

ROUTINE MAINTENANCE

WARNING:
ENSURE THAT THE POWER CORD TO THE MACHINE HAS BEEN
DISCONNECTED BEFORE CARRYING OUT ROUTINE
MAINTNENANCE

To ensure continued full efficiency of the dehumidifier, maintenance procedures should be performed as follows:

1. Clean the surface of the evaporator and condenser coils by blowing the dirt out from behind the fins with compressed air. Hold the nozzle of the air hose away from the coil to avoid damaging the fins. Alternatively, vacuum clean the coils.

WARNING:
DO NOT STEAM CLEAN REFRIGERATION COILS

2. Check that the fan is firmly secured to the motor shaft and that the fan rotates freely. **The fan motor is sealed for life and therefore does not need oiling.**
3. To check the refrigerant charge, run the unit for 15 minutes and briefly remove the evaporator filter cover. The evaporator coil should be evenly frost coated across its surface. At temperatures above 80°F, the coil may be covered with droplets of water rather than frost. Partial frosting accompanied by frosting of the thin capillary tubes, indicates loss of refrigerant gas or low charge.
4. Check all wiring connections.
5. In order to check the defrost operation, the unit needs to be operated in an ambient temperature of less than 59°F for at least 1 hour. When operated In this condition the unit should defrost at least once every hour. The defrost mode can be monitored by observing the ice melting on the coil face, prior to defrost the face will show a white coating of frost, which should clear during defrost

**IF ANY OF THE PRECEDING PROBLEMS OCCUR, CONTACT THE EBAC
SERVICE CENTER PRIOR TO CONTINUED OPERATION OF THE UNIT TO
PREVENT PERMANENT DAMAGE.**

REPAIRS

1. Should an electrical component fail, consult the Factory Service Center to obtain the proper replacement part.
2. If refrigerant gas is lost from the machine, it will be necessary to use a refrigeration technician to correct the fault. Contact the Factory Service Center prior to initiating this action.

Any competent refrigeration technician will be able to service the equipment. The following procedure must be used:

- a. The source of the leak must be determined and corrected.
- b. The machine should be thoroughly evacuated before recharging.
- c. The unit must be recharged with refrigerant measured accurately by weight.
- d. For evacuation and recharging of the machine, use the crimped and brazed charging stub attached to the side of the refrigerant compressor.

The charging stub should be crimped and rebrazed after servicing. **NEVER** allow permanent service valves to be fitted to any part of the circuit. Service valves may leak causing further loss of refrigerant gas.

3. The refrigerant compressor fitted to the dehumidifier is a durable unit that should give many years of service. Compressor failure can result from the machine losing its refrigerant gas. The compressor can be replaced by a competent refrigeration technician.

Failure of the compressor can be confirmed by the following procedure:

- a. Establish that power is present at the compressor terminals using a voltmeter.
- b. With the power disconnected, check the continuity of the internal winding by using meter across the compressor terminals. An open circuit indicates that the compressor should be replaced.
- c. Check that the compressor is not grounded by establishing that a circuit does not exist between the compressor terminals and the shell of the compressor.

TROUBLESHOOTING

<u>SYMPTOM</u>	<u>CAUSE</u>	<u>REMEDY</u>
Unit inoperative	1. No power to unit	1. Check the power from power supply panel
Little or no airflow	1. Fan motor burnt out 2. Dirty refrigeration coils 3. Loose electrical wiring	1. Replace the fan motor 2. See <i>Routine Maintenance</i> Section 3. Check the wiring diagram to find fault and repair
Little or no water extraction	1. Insufficient air flow 2. Compressor fault 3. Loss of refrigerant gas	1. Check all of the above 2. Contact the Factory Service Center 3. Contact the Factory Service Center
Little or no defrost when required	1. Faulty timer 2. Faulty by-pass valve	1. Contact the Factory Service Center 2. Contact the Factory Service Center
Unit vibrates excessively	1. Loose compressor 2. Damaged fan	1. Tighten the nuts on the compressor mounts 2. Replace fan
Water flooding inside the machine	1. Drain pipe blocked/frozen 2. Drain pipe too high 3. Crimped or blocked tubing	1. Clear the obstruction 2. Ensure that no section of the drain hose is 1M max. above the level of the water outlet 3. Straighten, clear, or replace tubing

CD85 SPARE PARTS LIST

<u>NUMBER</u>	<u>DESCRIPTION</u>	<u>PART NUMBER</u>	<u>QUANTITY</u>
1	Defrost Timer	1619508	1
2	Thermistor assembly	3035142	1
2	Control Knob	2018644	1
3	Capillary Tube	3014254	2 x 24"
4	Solenoid Valve	3020814	1
5	Filter Dryer	3020909	1
6	Compressor	3022198	1
7	Solenoid Coil	3030421	1
8	Capacitor	3030908	1
9	Humidistat	3035147	1
10	Mains Lead	3035148	1
11	Fan Motor	3040262	1
12	Fan Motor Inlet Ring	3040254	1
13	Fan Motor Capacitor	3030893	1
14	Relay	3036157	1
15	Rubber Foot	3101436	1
16	Drain Tubing	3014338	9 Feet
17	Condensate Pump	3160102	1
18	Condenser Coil	2029322	1
19	Evaporator Coil	2029323	1

Spare parts available online

www.EIPLDIRECT.com



Drawing	: - TPC361
Issue	: - 7
Date	: - 09/03/15

LIMITED WARRANTY

Our products carry a one-year unconditional warranty against any defects in workmanship or material. This warranty will cover all parts and labor required to repair your Ebac product. This warranty is invalid if the unit has been abused, damaged, whether intentional or accidental, or if any modifications have been made to the unit.

THE FOREGOING WARRANTY IS EXCLUSIVE AND IS ISSUED IN LIEU OF ALL OTHER WARRANTIES (WHETHER WRITTEN, ORAL, OR IMPLIED) INCLUDING THE WARRANTY OF MERCHANTABILITY AND THE WARRANTY OF FITNESS FOR A PARTICULAR PURPOSE. EBAC INDUSTRIAL PRODUCTS, INC. DISCLAIMS ANY LIABILITY FOR CONSEQUENTIAL DAMAGES, LOST PROFITS, OR INCIDENTAL DAMAGES FOR BREACH OF ANY WRITTEN OR IMPLIED WARRANTY WITH RESPECT TO THE FOREGOING DESCRIBED MERCHANDISE.

For Your Records: Model: _____
 S/N: _____
 Date Received: _____

 SAVE THIS SECTION FOR YOUR RECORDS
 CLIP AND RETURN THIS CARD

PLEASE NOTE

To ensure that your Ebac Dehumidifier is accorded the full coverage provided by this warranty, please complete and mail this card at your earliest convenience.

Thank You

WARRANTY REGISTRATION		
MODEL _____	S/N _____	DATE RECEIVED _____
OWNER _____		
ADDRESS _____		
CITY _____ STATE _____ ZIP _____		
COMMENTS _____		

Ebac Industrial Products. 700 Thimble Shoals Boulevard, Suite 109, Newport News, Virginia. 23606-2575		



Drawing	: - TPC361
Issue	: - 7
Date	: - 09/03/15



Drawing	: - TPC361
Issue	: - 7
Date	: - 09/03/15



Drawing	: - TPC361
Issue	: - 7
Date	: - 09/03/15



Drawing	: - TPC361
Issue	: - 7
Date	: - 09/03/15

UK Head Office

Ebac Industrial Products Ltd
St Helens Trading Estate
Bishop Auckland
County Durham
DL14 9AD

Tel: +44 (0) 1388 664400
Fax: +44 (0) 1388 662590

www.eipl.co.uk
sales@eipl.co.uk

American Sales Office

Ebac Industrial Products Inc
700 Thimble Shoals Blvd.
Suite 109, Newport News
Virginia, 23606-2575
USA

Tel: +01 757 873 6800
Fax: +01 757 873 3632

www.ebacusa.com
sales@ebacusa.com

German Sales Office

Ebac Industrial Products Ltd.
Gartenfelder Str. 29-37
Gebäude 35
D-13599, Berlin
Germany

Tel: +49 3043 557241
Fax: +49 3043 557240

www.eip-ltd.de
sales@eip-ltd.de