

FOR QUESTIONS, CALL THE
 FLD AIRE NATIONAL
 REGION 22
 PHONE: (610) 239-8405
 EMAIL: courtney.hardin@floaire.com

PATENT NUMBERS

AC-PSP (UNITED STATES) - US PATENT 7963830 B2.
 AC-PSP WALL (CANADA) - CA PATENT 2820509.
 AC-PSP ISLAND (CANADA) - CA PATENT 2520330.

HOOD INFORMATION - JOB#5910226

HOOD NO	TAG	MODEL	MANUFACTURER	LENGTH	MAX COOKING TEMP	TYPE	APPLIANCE DUTY	DESIGN CFM/FT	TOTAL EXH CFM	EXHAUST PLENUM RISER(S)						TOTAL SUPPLY CFM	HOOD CONSTRUCTION	HOOD CONFIG		
										WIDTH	LENG	HEIGHT	DIA	CFM	VEL			SP	END TO END	RDW
1	8' Heated	5424 FX-2-PSP-F	FLDAIRE	8' 0"	600 DEG	I	HEAVY	234	1872	10'	17'	4'		1872	1586	-0.944'	1498	430 SS WHERE EXPOSED	ALONE	ALONE

HOOD INFORMATION

HOOD NO	TAG	FILTER(S)					LIGHT(S)			UTILITY CABINET(S)				FIRE SYSTEM PIPING	HOOD HANGING WEIGHT				
		TYPE	QTY	HEIGHT	LENGTH	EFFICIENCY @ 7 MICRONS	QTY	TYPE	WIRE GUARD	LOCATION	SIZE	FIRE SYSTEM				ELECTRICAL	SWITCHES		
1	8' Heated	CAPTRATE SOLID FILTER	5	16"	16"	85% SEE FILTER SPEC	3	L55 SERIES E26	NO	LEFT	12"x54"x24"					SC-111110MA	1 LIGHT 1 FAN	NO	642 LBS

HOOD OPTIONS

HOOD NO	TAG	OPTION
1	8' Heated	RIGHT VERTICAL END PANEL 27' TOP WIDTH, 21' BOTTOM WIDTH, 80" HIGH INSULATED 430 SS.
		LEFT VERTICAL END PANEL 27' TOP WIDTH, 21' BOTTOM WIDTH, 80" HIGH INSULATED 430 SS.
		SENSOR-CV.

PERFORATED SUPPLY PLENUM(S)

HOOD NO	TAG	POS	LENGTH	WIDTH	HEIGHT	TYPE	RISER(S)				
							WIDTH	LENG	DIA	CFM	SP
1	8' Heated	Front	108'	16'	6'	MUA	12"	28"		749	0.181'
						MUA	12"	28"		749	0.181'

SPECIFICATION: CAPTRATE® GREASE-STOP® SOLID FILTER

THE CAPTRATE GREASE-STOP SOLID FILTER IS A SINGLE-STAGE FILTER FEATURING A UNIQUE S-Baffle DESIGN IN CONJUNCTION WITH A SLOTTED REAR Baffle DESIGN, TO DELIVER EXCEPTIONAL FILTRATION EFFICIENCY.


FILTER IS STAINLESS STEEL CONSTRUCTION, AND SIZED TO FIT INTO STANDARD 2-INCH DEEP HOOD CHANNEL(S).

UNITS SHALL INCLUDE STAINLESS STEEL HANDLES AND A FASTENING DEVICE TO SECURE THE TWO COMPONENTS WHEN ASSEMBLED.


GREASE EXTRACTION EFFICIENCY PERFORMANCE SHALL REMOVE AT LEAST 75% OF GREASE PARTICLES FIVE MICRONS IN SIZE, AND 85% GREASE PARTICLES SEVEN MICRONS IN SIZE AND LARGER, WITH A CORRESPONDING PRESSURE DROP NOT TO EXCEED 1.0 INCHES OF WATER GAUGE.

THE CAPTRATE GREASE-STOP SOLID WAS TESTED TO ASTM STANDARD ASTM F2519-05. MANUFACTURER APPROVED FOR USE IN SOLID FUEL APPLICATIONS AS A SPARK ARRESTER.


EFFICIENCY VS. PARTICLE DIAMETER

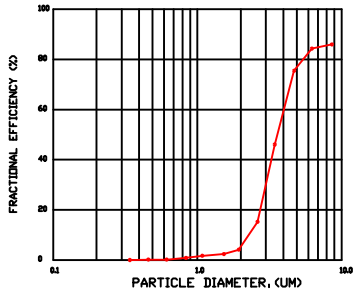

PRESSURE DROP VS. FLOW RATE

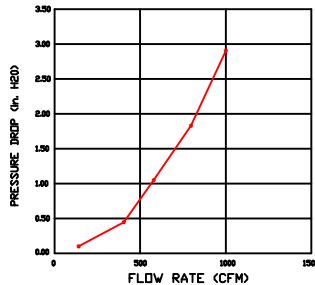

CAPTRATE FILTERS ARE BUILT IN COMPLIANCE WITH:
 NFPA #96.
 NSF STANDARD #2.
 UL STANDARD #1046.
 INT. MECH. CODE (IMC).
 ULC-S649.

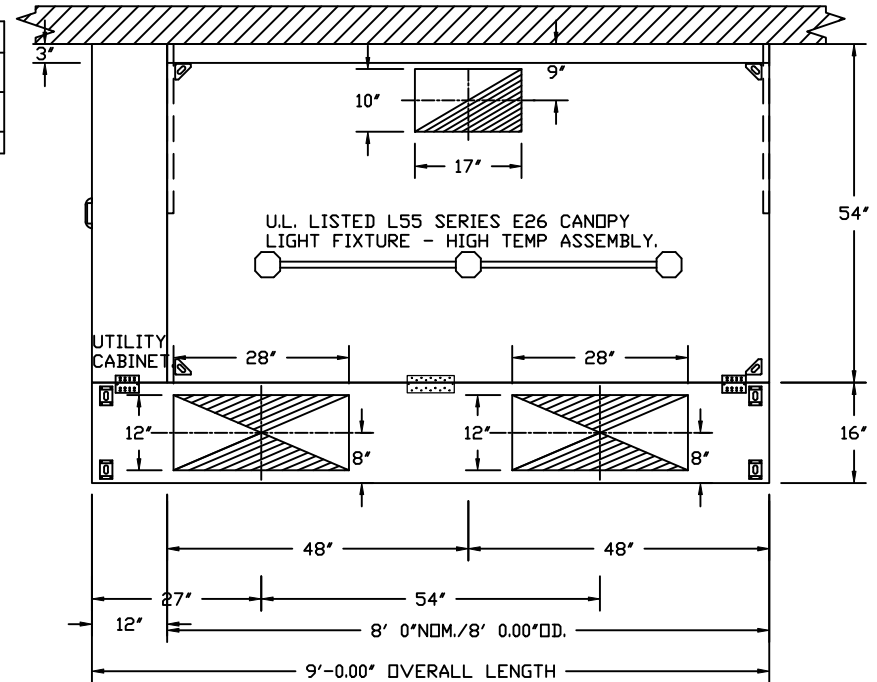


PLAN VIEW - HOOD #1 (8' Heated)
 8' 0.00" LONG 5424FX-2-PSP-F




FloAire

JOB 8' Heated UC Left** Hood Stock	
LOCATION ,	
DATE 3/20/2023	JOB # 5910226
DWG # 1	DRAWN BY courtneyh
REV.	SCALE 3/8" = 1'-0"

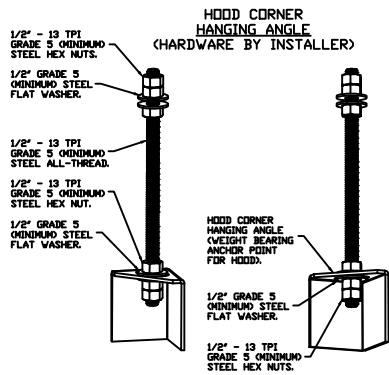


ASSEMBLY INSTRUCTIONS

HANGING ANGLE MUST BE SUPPORTED WITH 1/2" - 13 TPI GRADE 5 (MINIMUM) ALL-THREAD. SANDWICH HANGING ANGLES AND CEILING ANCHOR POINTS WITH 1/2" GRADE 5 (MINIMUM) STEEL FLAT WASHERS AND 1/2" - 13 TPI GRADE 5 (MINIMUM) HEX NUTS AS SHOWN. MUST USE DOUBLED HEX NUT CONFIGURATION BENEATH HOOD HANGING ANGLES AND ABOVE CEILING ANCHORS. MAINTAIN 1/4" OF EXPOSED THREADS BENEATH BOTTOM HEX NUT. TORQUE ALL HEX NUTS TO 57 FT-LBS.

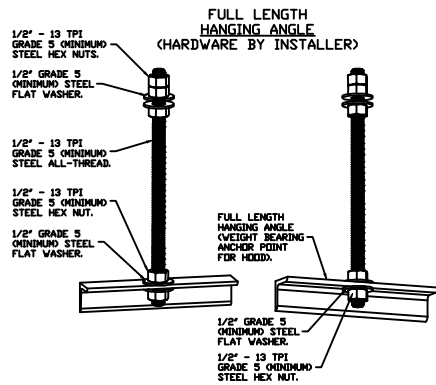

ASSEMBLY INSTRUCTIONS

HANGING ANGLE MUST BE SUPPORTED WITH 1/2" - 13 TPI GRADE 5 (MINIMUM) ALL-THREAD. SANDWICH HANGING ANGLES AND CEILING ANCHOR POINTS WITH 1/2" GRADE 5 (MINIMUM) STEEL FLAT WASHERS AND 1/2" - 13 TPI GRADE 5 (MINIMUM) HEX NUTS AS SHOWN. MUST USE DOUBLED HEX NUT CONFIGURATION ABOVE CEILING ANCHORS. SINGLE HEX NUT BENEATH HANGING ANGLE IS ACCEPTABLE FOR FULL LENGTH HANGING ANGLES. MAINTAIN 1/4" OF EXPOSED THREADS BENEATH BOTTOM HEX NUT. TORQUE ALL HEX NUTS TO 57 FT-LBS.

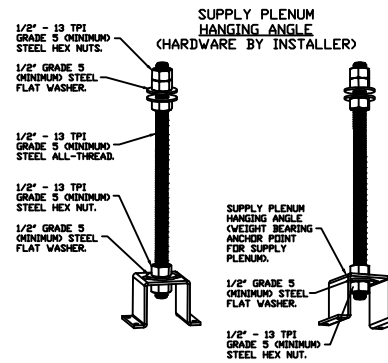


ASSEMBLY INSTRUCTIONS

HANGING ANGLE MUST BE SUPPORTED WITH 1/2" - 13 TPI GRADE 5 (MINIMUM) ALL-THREAD. SANDWICH HANGING ANGLES AND CEILING ANCHOR POINTS WITH 1/2" GRADE 5 (MINIMUM) STEEL FLAT WASHERS AND 1/2" - 13 TPI GRADE 5 (MINIMUM) HEX NUTS AS SHOWN. MUST USE DOUBLED HEX NUT CONFIGURATION ABOVE CEILING ANCHORS. SINGLE HEX NUT BENEATH HANGING ANGLE IS ACCEPTABLE FOR PSP HANGING ANGLES. MAINTAIN 1/4" OF EXPOSED THREADS BENEATH BOTTOM HEX NUT. TORQUE ALL HEX NUTS TO 57 FT-LBS.




FloAire

JOB# Heated UC Left** Hood Stock	
LOCATION ,	
DATE 3/20/2023	JOB # 5910226
DWG # 2	DRAWN BY courtneyh
REV.	SCALE 3/8" = 1'-0"

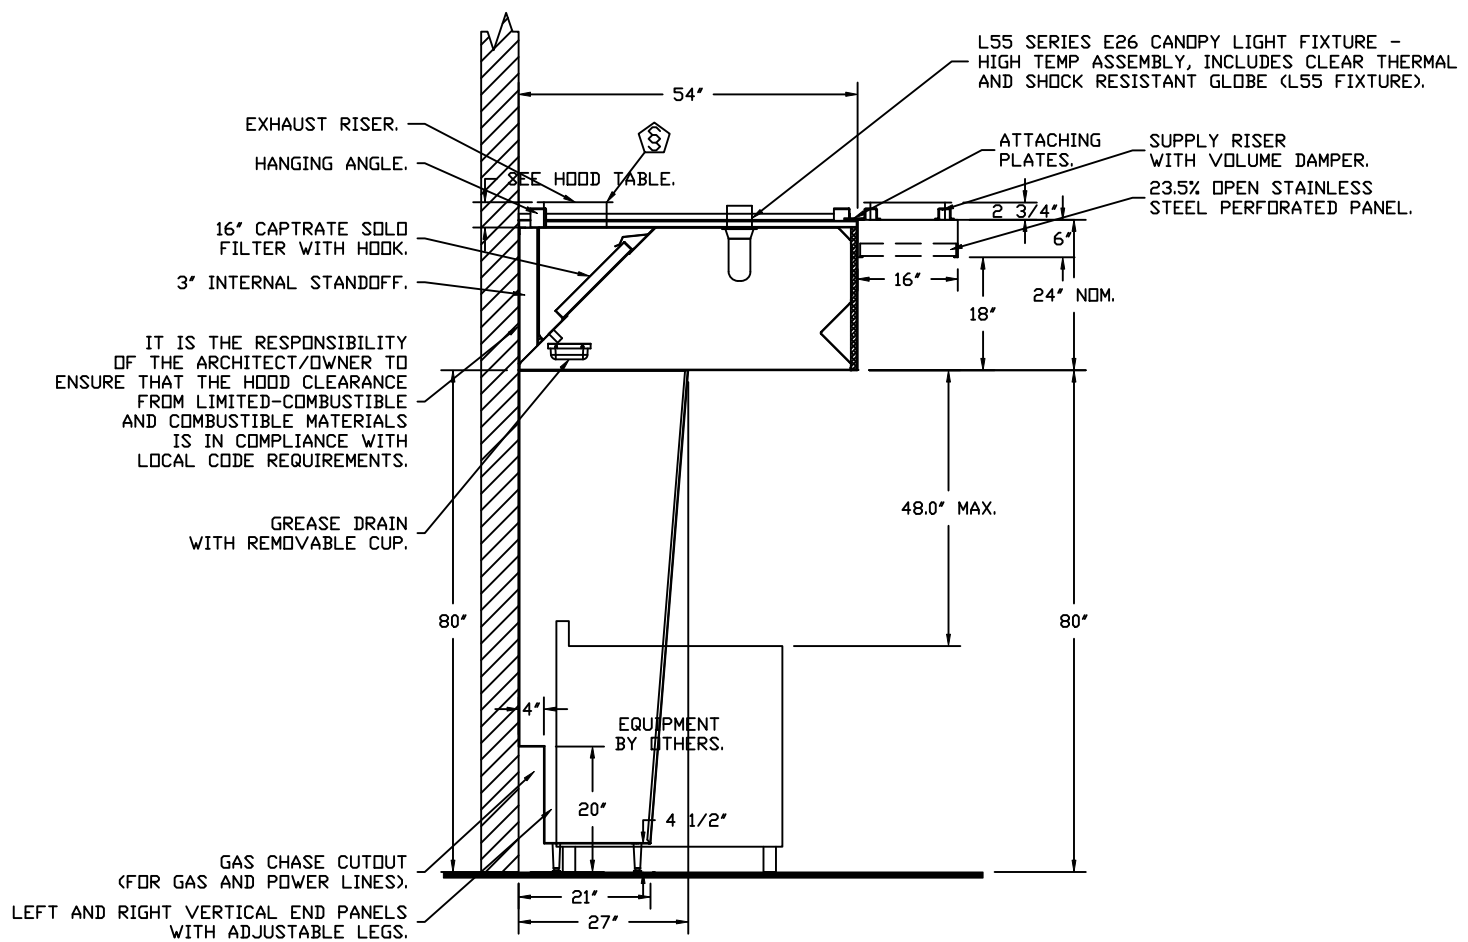

**SECTION VIEW - MODEL 5424FX-2-PSP-F
HOOD - #1 (8' Heated)**



FloAire

JOB 8' Heated UC Left** Hood Stock	
LOCATION ,	
DATE 3/20/2023	JOB # 5910226
DWG # 3	DRAWN BY courtneyh
REV.	SCALE 3/8" = 1'-0"

EXHAUST FAN INFORMATION - JOB#5910226

FAN UNIT NO	TAG	QTY	FAN UNIT MODEL #	MANUFACTURER	CFM	ESP	RPM	MOTOR ENCL	HP	BHP	PHASE	VOLT	FLA	DISCHARGE VELOCITY	WEIGHT (LBS)	SDNES
1	8' HEATED	1	DUBSH	FLOAIRE	1872	1.100	1429	TEAO-ECM	0.750	0.5280	1	115	8.9	592 FPM	94	13.4

MUA FAN INFORMATION - JOB#5910226

FAN UNIT NO	TAG	QTY	FAN UNIT MODEL #	BLOWER	HOUSING	MIN CFM	DESIGN CFM	ESP	RPM	MOTOR ENCL	HP	BHP	PHASE	VOLT	FLA	MCA	MDCP	WEIGHT (LBS)	SDNES
2	8' HEATED	1	F1-D.500-15D	15MF-1-MDD	A1-D.500	1000	1498	0.300	1575	TEAO-ECM	1.000	0.6090	1	115	11.6	14.5A	25A	462	12.7

GAS FIRED MAKE-UP AIR UNIT(S)

FAN UNIT NO	TAG	INPUT BTUs	OUTPUT BTUs	TEMP RISE	REQUIRED INPUT GAS PRESSURE	GAS TYPE	BURNER EFFICIENCY(%)
2	8' HEATED	118445	108969	70°F	7 IN. W.C. - 14 IN. W.C.	NATURAL	92

FAN OPTIONS

FAN UNIT NO	TAG	QTY	DESCRIPTION
1	8' HEATED	1	GREASE BDX
		1	HINGE KIT - SHIPS LOOSE FOR CURB SUPPLIED BY OTHERS
		1	ECM WIRING PACKAGE - EXHAUST - MODBUS CONTROL -MSC- (TELCD), CCW ROTATION
		1	2 YEAR PARTS WARRANTY
2	8' HEATED	1	SIZE 1 TEMPERED COMMERCIAL DOWN DISCHARGE FOR DIRECT DRIVE AHUS
		1	INLET PRESSURE GAUGE, 0-35"
		1	MANIFOLD PRESSURE GAUGE, -5 TO 15" WC
		1	LDW FIRE START
		1	SHIP LOOSE GAS STRAINER 3/4"
		1	MOTORIZED BACKDRAFT DAMPER FOR A1-D HOUSING - MEETS AMCA CLASS 1A RATING
		1	FREEZESTAT (10)
		1	ECM WIRING PACKAGE - DD SUPPLY - MODBUS CONTROL-MSC- (TELCD)
1	2 YEAR PARTS WARRANTY		

FAN ACCESSORIES

FAN UNIT NO	TAG	EXHAUST			SUPPLY			
		GREASE CUP	GRAVITY DAMPER	WALL MOUNT	SIDE DISCHARGE	GRAVITY DAMPER	MOTORIZED DAMPER	WALL MOUNT
1	8' HEATED	YES						
2	8' HEATED						YES	

CURB ASSEMBLIES

NO	DN FAN	TAG	WEIGHT	ITEM	SIZE
1	# 1	8' HEATED	32 LBS	CURB	23.000"W X 23.000"L X 20.000"H ALONG LENGTH, RIGHT VENTED.
2	# 2	8' HEATED	65 LBS	CURB	21.000"W X 71.000"L X 20.000"H ALONG WIDTH, RIGHT INSULATED.

FAN SOUND DATA



FAN UNIT NO	TAG	MOTOR	SOUND DATA			OCTAVE BAND SOUND DATA								
			LWA	SDNES @ 5 FT	DBA @ 5 FT	DISTANCE (FT)	63 HZ	125 HZ	250 HZ	500 HZ	1 KHZ	2 KHZ	4 KHZ	8 KHZ
1	8' HEATED	EXHAUST	76.9	13.3815377654901	65.4	5	78.3	78.2	81.1	72.9	69.8	67.7	63.3	57.1
2	8' HEATED	SUPPLY	76.2	12.7474021432839	64.7	5	73.3	77.7	77.1	72.7	69.4	68.2	66.5	62.9



FloAire

JOB#8' Heated UC Left** Hood Stock	
LOCATION ,	
DATE 3/20/2023	JOB # 5910226
DWG # 4	DRAWN BY courtneyh
REV.	SCALE 3/8" = 1'-0"

FAN #1 DU85H - EXHAUST FAN (8' HEATED)

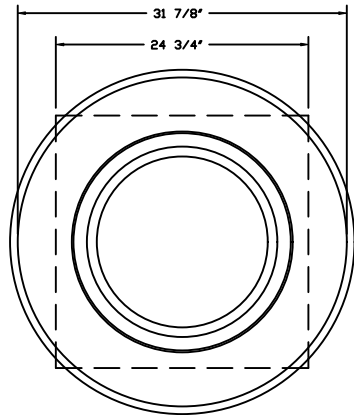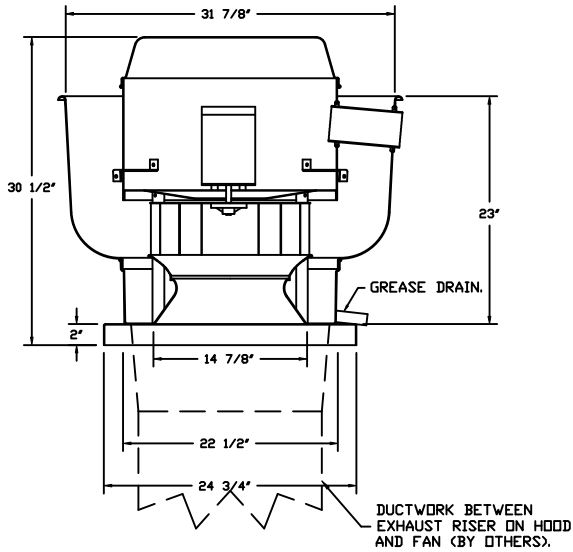

TOP VIEW

FEATURES:


- DIRECT DRIVE CONSTRUCTION (NO BELTS/PULLEYS).
- ROOF MOUNTED FANS.
- RESTAURANT MODEL.
- UL705 AND UL762 AND ULC-S645
- VARIABLE SPEED CONTROL.
- INTERNAL WIRING.
- THERMAL OVERLOAD PROTECTION (SINGLE PHASE).
- HIGH HEAT OPERATION 300°F (149°C).
- GREASE CLASSIFICATION TESTING.
- NEMA 3R SAFETY DISCONNECT SWITCH.

NORMAL TEMPERATURE TEST
 EXHAUST FAN MUST OPERATE CONTINUOUSLY WHILE EXHAUSTING AIR AT 300°F (149°C) UNTIL ALL FAN PARTS HAVE REACHED THERMAL EQUILIBRIUM, AND WITHOUT ANY DETERIORATING EFFECTS TO THE FAN WHICH WOULD CAUSE UNSAFE OPERATION.

ABNORMAL FLARE-UP TEST
 EXHAUST FAN MUST OPERATE CONTINUOUSLY WHILE EXHAUSTING BURNING GREASE VAPORS AT 600°F (316°C) FOR A PERIOD OF 15 MINUTES WITHOUT THE FAN BECOMING DAMAGED TO ANY EXTENT THAT COULD CAUSE AN UNSAFE CONDITION.

OPTIONS

- GREASE BOX.
- HINGE KIT - SHIPS LOOSE FOR CURB SUPPLIED BY OTHERS.
- ECM WIRING PACKAGE - EXHAUST - MODBUS CONTROL
- MSC- (TELCO), CCW ROTATION.
- 2 YEAR PARTS WARRANTY.


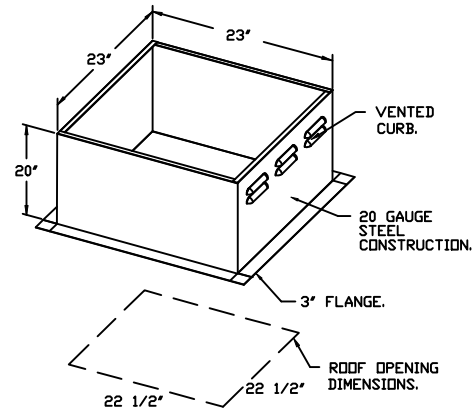


FloAire

JOB 8' Heated UC Left** Hood Stock	
LOCATION ,	
DATE 3/20/2023	JOB # 5910226
DWG # 5	DRAWN BY courtneyh
REV.	SCALE 3/8" = 1'-0"

FAN#1 (8' HEATED) - EXHAUST PERFORMANCE CURVES.

1872 CFM, 1.1 SP @ 1429 RPM AND 0.528 BHP AT 0 FEET AND 120 DEG F.
 * PLEASE NOTE THAT THESE CURVES WERE ADJUSTED FOR JOB SPECIFIC TEMPERATURE AND ALTITUDE.

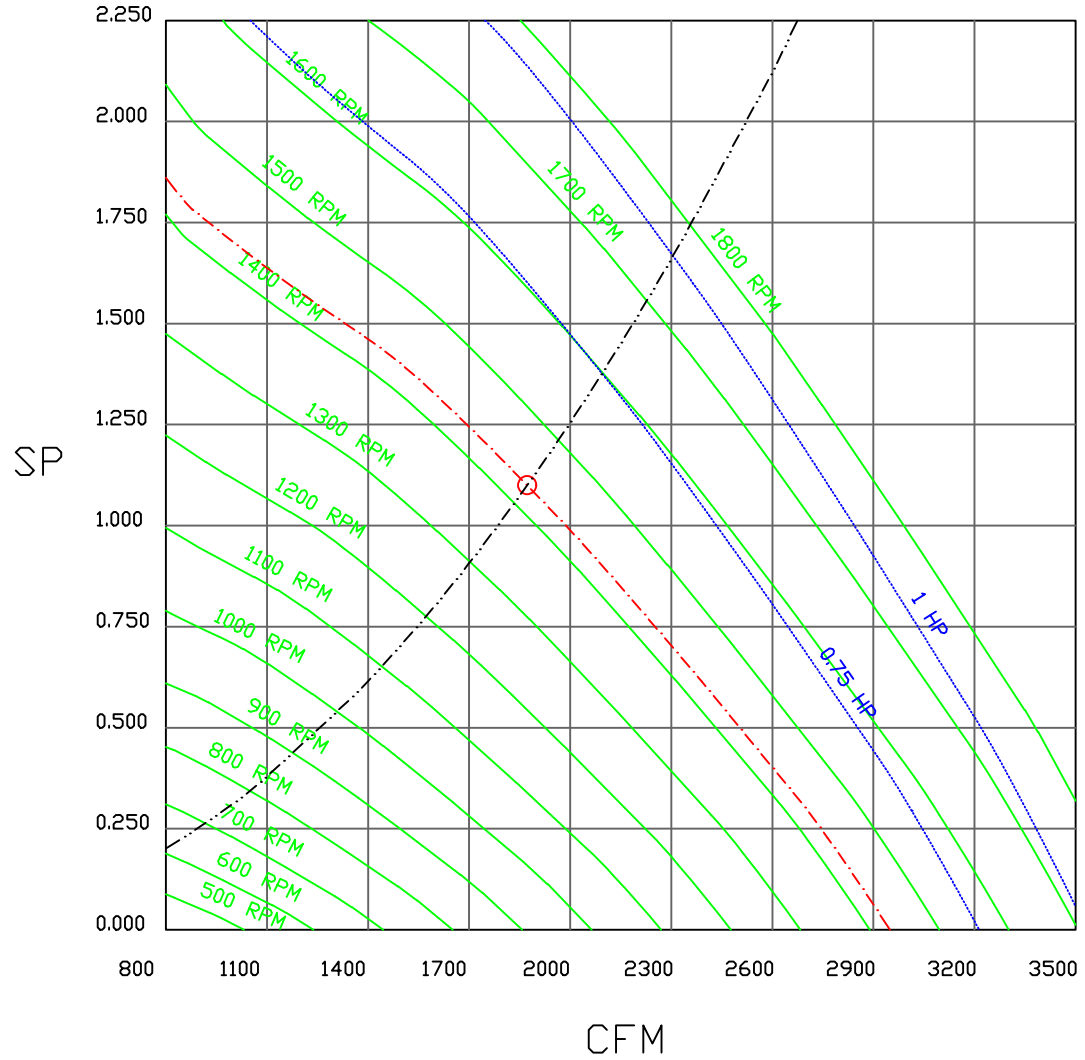

FloAire


JOB 8' Heated UC Left** Hood Stock	
LOCATION ,	
DATE 3/20/2023	JOB # 5910226
DWG # 6	DRAWN BY courtneyh
REV.	SCALE 3/8" = 1'-0"

- FAN #2 F1-D.500-1SD - HEATER (8' HEATED)
1. DIRECT GAS FIRED HEATED MAKE UP AIR UNIT WITH 15' MIXED FLOW DIRECT DRIVE FAN.
 2. INTAKE HOOD WITH E2 FILTERS.
 3. DOWN DISCHARGE - AIR FLOW RIGHT -> LEFT.
 4. DOWN DISCHARGE CONSTRUCTION FOR SIZE 1 DIRECT DRIVE AHUS.
 5. GAS PRESSURE GAUGE, 0-35", 2.5" DIAMETER, 1/4" THREAD SIZE.
 6. GAS PRESSURE GAUGE, -5 TO +15 INCHES WC, 2.5" DIAMETER, 1/4" THREAD SIZE.
 7. LOW FIRE START. ALLOWS THE BURNER CIRCUIT TO ENERGIZE WHEN THE MODULATION CONTROL IS IN A LOW FIRE POSITION.
 8. SHIP LOOSE GAS STRAINER. TO BE INSTALLED UPSTREAM OF UNIT CONNECTION. 3/4" CONNECTION.
 9. MOTORIZED BACK DRAFT DAMPER 16" X 18" FOR SIZE 1 STANDARD & MODULAR HEATER UNITS W/EXTENDED SHAFT, STANDARD GALVANIZED CONSTRUCTION, 3/4" REAR FLANGE, LOW LEAKAGE, TFB120S ACTUATOR INCLUDED.
 10. FREEZE STAT WITH 10' SENSOR. FACTORY SET AT 35°F AND 10 MINUTES.
 11. ECM WIRING PACKAGE MODBUS CONTROL FOR SUPPLY EC MOTORS. MSC CONTROLLER. **DO NOT ORDER UNDER WARRANTY, SEE PART NUMBER *CAS MSC**.
 12. HINGED DOUBLE WALL INSULATED DOOR ASSEMBLY (BURNER/BLOWER SECTION).
 13. 2 YEAR PARTS WARRANTY

*NOTE: SUPPLY DUCT MUST BE INSTALLED TO MEET SMACNA STANDARDS. A MINIMUM STRAIGHT DUCT LENGTH MUST BE MAINTAINED DOWNSTREAM OF UNIT DISCHARGE AS OUTLINED IN AMCA PUBLICATION 201. WHEN USING RECTANGULAR DUCTWORK, ELBOWS MUST BE RADIUS THROAT, RADIUS BACK WITH TURNING VANES. FLEXIBLE DUCTWORK AND SQUARE THROAT/SQUARE BACK ELBOWS SHOULD NOT BE USED. ANY TRANSITION AND/OR TURNS IN THE DUCTWORK WILL CAUSE SYSTEM EFFECT. SYSTEM EFFECT WILL DRASTICALLY INCREASE STATIC PRESSURE AND REDUCE AIRFLOW. DO NOT RELY ON UNIT TO SUPPORT DUCT IN ANY WAY. FAILURE TO PROPERLY SIZE DUCTWORK MAY CAUSE SYSTEM EFFECTS AND REDUCE PERFORMANCE OF THE EQUIPMENT. SUGGESTED STRAIGHT DUCT SIZE IS 14" X 14".

SUPPLY SIDE HEATER INFORMATION:

WINTER TEMPERATURE = 20°F. TEMP. RISE = 70°F.
 BTUs CALCULATED OFF ACTUAL AIR DENSITY.
 OUTPUT BTUs AT ALTITUDE OF 0.0 FT. = 108969.
 INPUT BTUs AT ALTITUDE OF 0.0 FT. = 118445.







DIRECT FIRED GAS PROFILE PLATE ASSEMBLY

SAFETY NOTE: BURNER PLATE ASSEMBLY INFORMATION
 DIRECT FIRED BURNER SHALL HAVE PATENTED GAS PATENT NO. 4,048,889. SELF-ALIGNING PROFILE PLATE ASSEMBLY IS DESIGNED TO MAINTAIN PROPER AIR VELOCITY AND PREVENT LEAKS ACROSS THE BURNER PROFILE PLATE. BURNER SHALL BE INSTALLED TO MAINTAIN PROPER AIR VELOCITY AND PREVENT LEAKS ACROSS THE BURNER PROFILE PLATE. BURNER SHALL BE INSTALLED TO MAINTAIN PROPER AIR VELOCITY AND PREVENT LEAKS ACROSS THE BURNER PROFILE PLATE. BURNER SHALL BE INSTALLED TO MAINTAIN PROPER AIR VELOCITY AND PREVENT LEAKS ACROSS THE BURNER PROFILE PLATE.

SAFETY NOTE: BURNER PROFILE PLATE ASSEMBLY INFORMATION
 BURNER PROFILE PLATE ASSEMBLY IS DESIGNED TO MAINTAIN PROPER AIR VELOCITY AND PREVENT LEAKS ACROSS THE BURNER PROFILE PLATE. BURNER SHALL BE INSTALLED TO MAINTAIN PROPER AIR VELOCITY AND PREVENT LEAKS ACROSS THE BURNER PROFILE PLATE. BURNER SHALL BE INSTALLED TO MAINTAIN PROPER AIR VELOCITY AND PREVENT LEAKS ACROSS THE BURNER PROFILE PLATE.

GENERAL NOTES:
 ALL PROFILE PLATE ASSEMBLIES SHALL BE DELIVERED IN THE UPON DELIVERY AND COMPLY WITH CURRENT SAFETY STANDARDS AND CAN BE USED FOR RE-CIRCULATION OF HEATED AIR AND 2018 RE-CIRCULATION OF HEATED AIR.

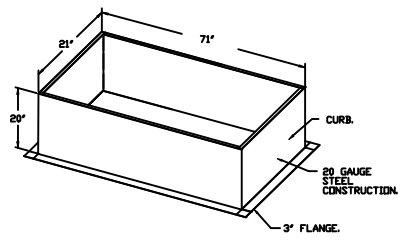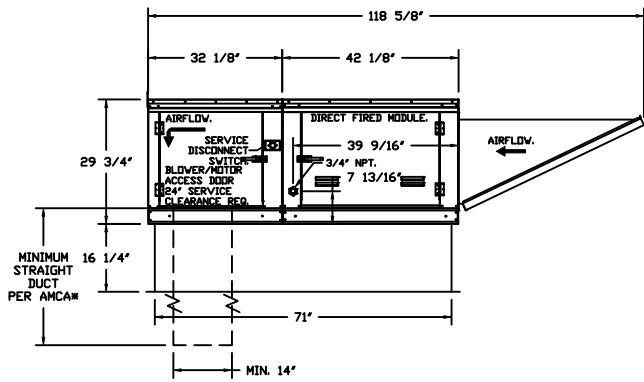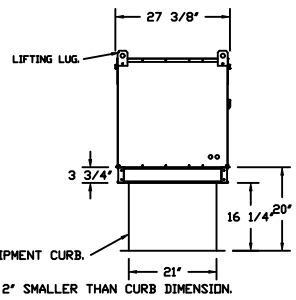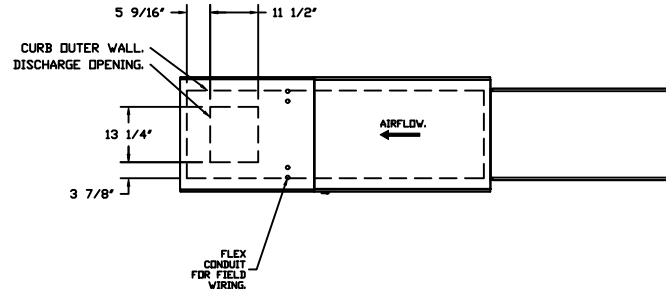


FloAire

JOB# 8' Heated UC Left** Hood Stock	
LOCATION ,	
DATE 3/20/2023	JOB # 5910226
DWG # 7	DRAWN BY courtneyh
REV.	SCALE 1/4" = 1'-0"

FAN#2 (8' HEATED) - HEATER PERFORMANCE CURVES.

1498 CFM, 0.343 SP @ 1575 RPM AND 0.609 BHP AT 0 FEET AND 90 DEG F.
 * PLEASE NOTE THAT THESE CURVES WERE ADJUSTED FOR JOB SPECIFIC TEMPERATURE AND ALTITUDE.

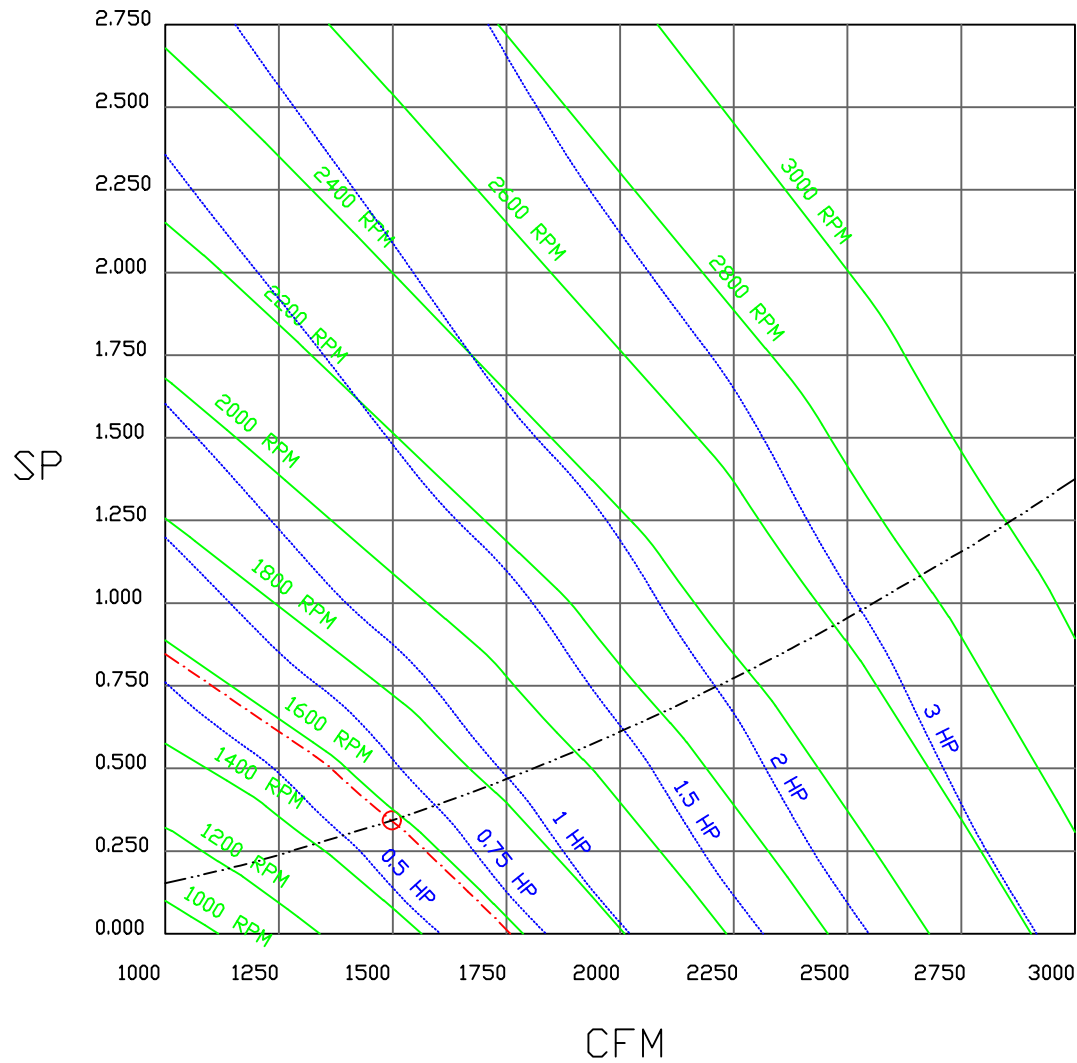

FloAire

JOB 8' Heated UC Left** Hood Stock	
LOCATION ,	
DATE 3/20/2023	JOB # 5910226
DWG # 8	DRAWN BY courtneyh
REV.	SCALE 3/8" = 1'-0"



GREASE DUCT & CHIMNEY SPECIFICATIONS:

PROVIDE GREASE DUCT EQUAL TO FLOAIRE MODEL "FDW"
ROUND 20 GAUGE 430 STAINLESS STEEL DUCTWORK. MODEL "FDW"
IS LISTED TO UL-1978 AND IS INSTALLED USING "V" CLAMP LOCKING
CONNECTIONS SEALED WITH 3M FIRE BARRIER 2000 PLUS. MODEL "FDW"
DOES NOT REQUIRE WELDING PROVIDING IT HAS BEEN INSTALLED PER
THE MANUFACTURES INSTALLATION GUIDE.

PROVIDE RATED ACCESS DOORS AT EVERY CHANGE IN DIRECTION AND EVERY 12' ON CENTER.
PER MANUFACTURES LISTING MODEL "FDW" HORIZONTAL RUNS LESS THAN 75 FT. CAN BE
SLOPED 1/16" PER 12", HORIZONTAL RUNS MORE THAN 75 FT. CAN BE SLOPED 3/16" PER 12".
DUCT SHOULD BE SLOPED AS MUCH AS POSSIBLE TO REDUCE THE CHANCE OF GREASE
ACCUMULATION IN HORIZONTAL RUNS.

IF THE DUCT OR CHIMNEY IS WITHIN 18 INCHES OF COMBUSTIBLE MATERIAL, PROVIDE
UL-2221 OR UL-103 HT LISTED DOUBLE WALL GREASE DUCT OR DOUBLE WALL CHIMNEY
EQUAL TO FLOAIRE MODEL "FDW- 2R, 2R TYPE HT, 3R, OR 3Z" ROUND 20 GAUGE 430
STAINLESS INNER DUCT INSULATED WITH A 24 GAUGE 430 STAINLESS OUTER SHELL.

CUSTOMER APPROVAL TO MANUFACTURE:

APPROVED AS NOTED	<input type="checkbox"/>
APPROVED WITH NO EXCEPTION TAKEN	<input type="checkbox"/>
REVISE AND RESUBMIT	<input type="checkbox"/>
SIGNATURE _____	
YOUR TITLE _____	DATE _____



FloAire

JOB 8' Heated UC Left** Hood Stock	
LOCATION ,	
DATE 3/20/2023	JOB # 5910226
DWG # 9	DRAWN BY courtneyh
REV.	SCALE 3/8" = 1'-0"

GREASE BOX INSTALLATION

GREASEBOX
REV.#2 08/19/02



PARTS INCLUDED

- GREASE BOX.
- GREASE BOX COVER.
- GREASE PIPE.
- SHEET METAL SCREWS
3 - LONG (3/4" LG.).

GREASE BOX FIELD INSTALLATION


STEP 1)

ATTACH GREASE BOX COVER TO THE CURB, HOLD 3" DIMENSION AS SHOWN ON PIC. 1. SCREW GREASE BOX COVER TO CURB USING (3) LONG (3/4" LG.) SCREWS AS SHOWN ON PIC. 2.

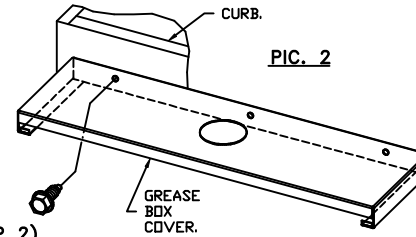


STEP 2)

ATTACH GREASE BOX TO GREASE BOX COVER, SLIDE AND DROP AS SHOWN ON PIC. 3.

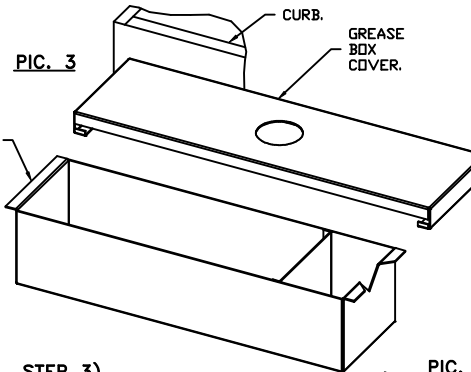


STEP 3)


INSTALL GREASE PIPE AS SHOWN ON PIC. 4.



CLOSED POSITION

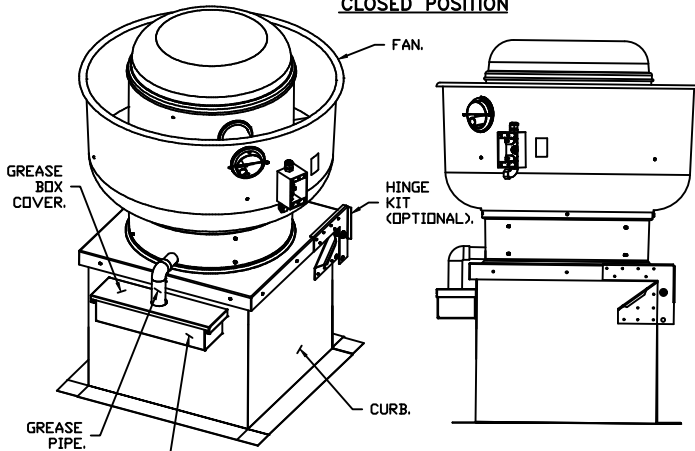

OPEN POSITION

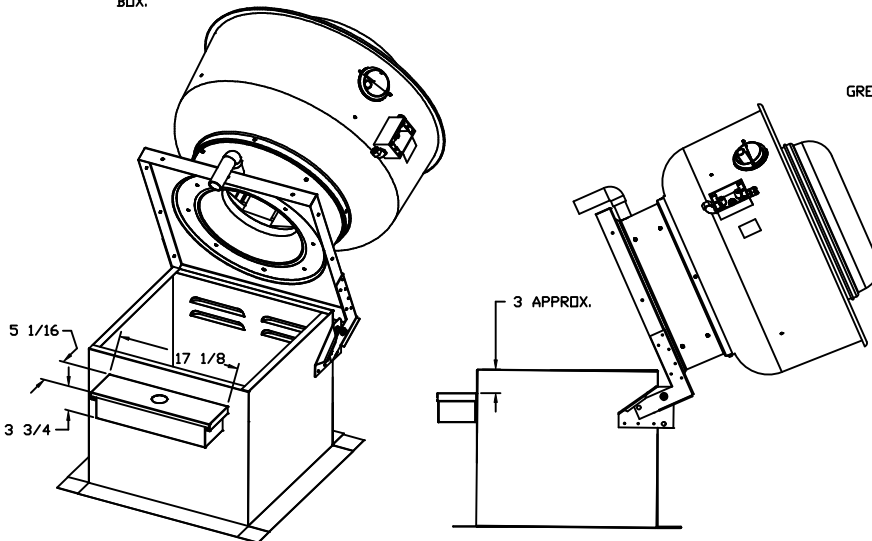

*NOTE: UL 705 INSTALL.



FloAire

JOB# 8' Heated UC Left** Hood Stock	
LOCATION ,	
DATE 3/20/2023	JOB # 5910226
DWG # 10	DRAWN BY courtneyh
REV.	SCALE 3/8" = 1'-0"


Exhaust Fan Wiring

JOB 5910226 - 8' Heated UC Left** Hood Stock

DRAWING NUMBER EXH5910226-1

SHIP DATE 3/20/2023

MODEL DUB5H

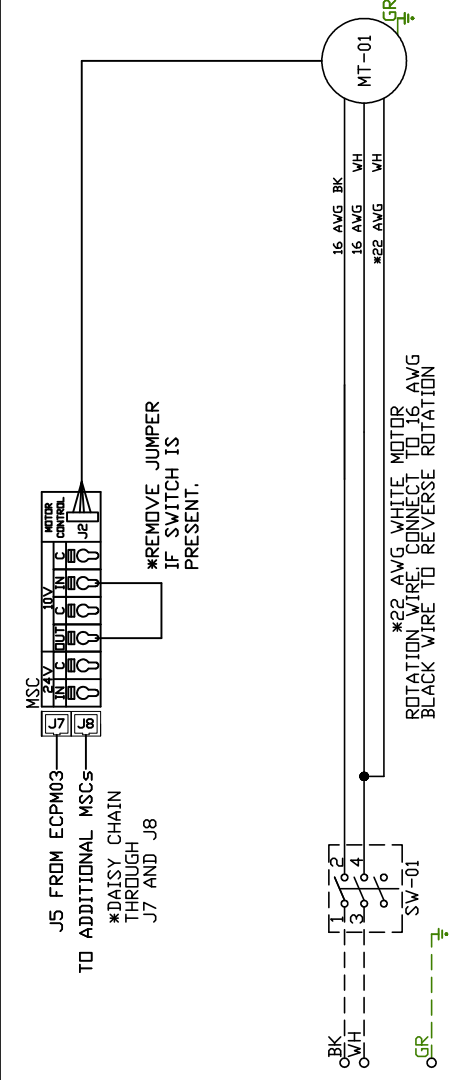

1

2

3

4

5

6

7

8

9

10

11

12

13

14

15

16

17

18

19

20

21

22

23

Installed Options

Component Identification Location

Label Description Location

MT-01 Fan Motor [3]

MSC Motor Speed Controller [1]

SW-01 Main disconnect switch [3]


MOTOR INED
EXHAUST 0.75HP-115V-IP-8-9FLA

ELECTRICAL INFORMATION
MOTOR/CTRL MCA: 11.2A
MOTOR/CTRL MOP: 20A

NOTES
--- DENOTES FIELD WIRING
--- DENOTES INTERNAL WIRING

WIRE COLOR

- BK - BLACK
- BL - BLUE
- BR - BROWN
- DR - ORANGE
- RD - RED
- WH - WHITE
- YW - YELLOW
- GR - GREEN
- GY - GRAY
- PR - PURPLE
- PK - PINK

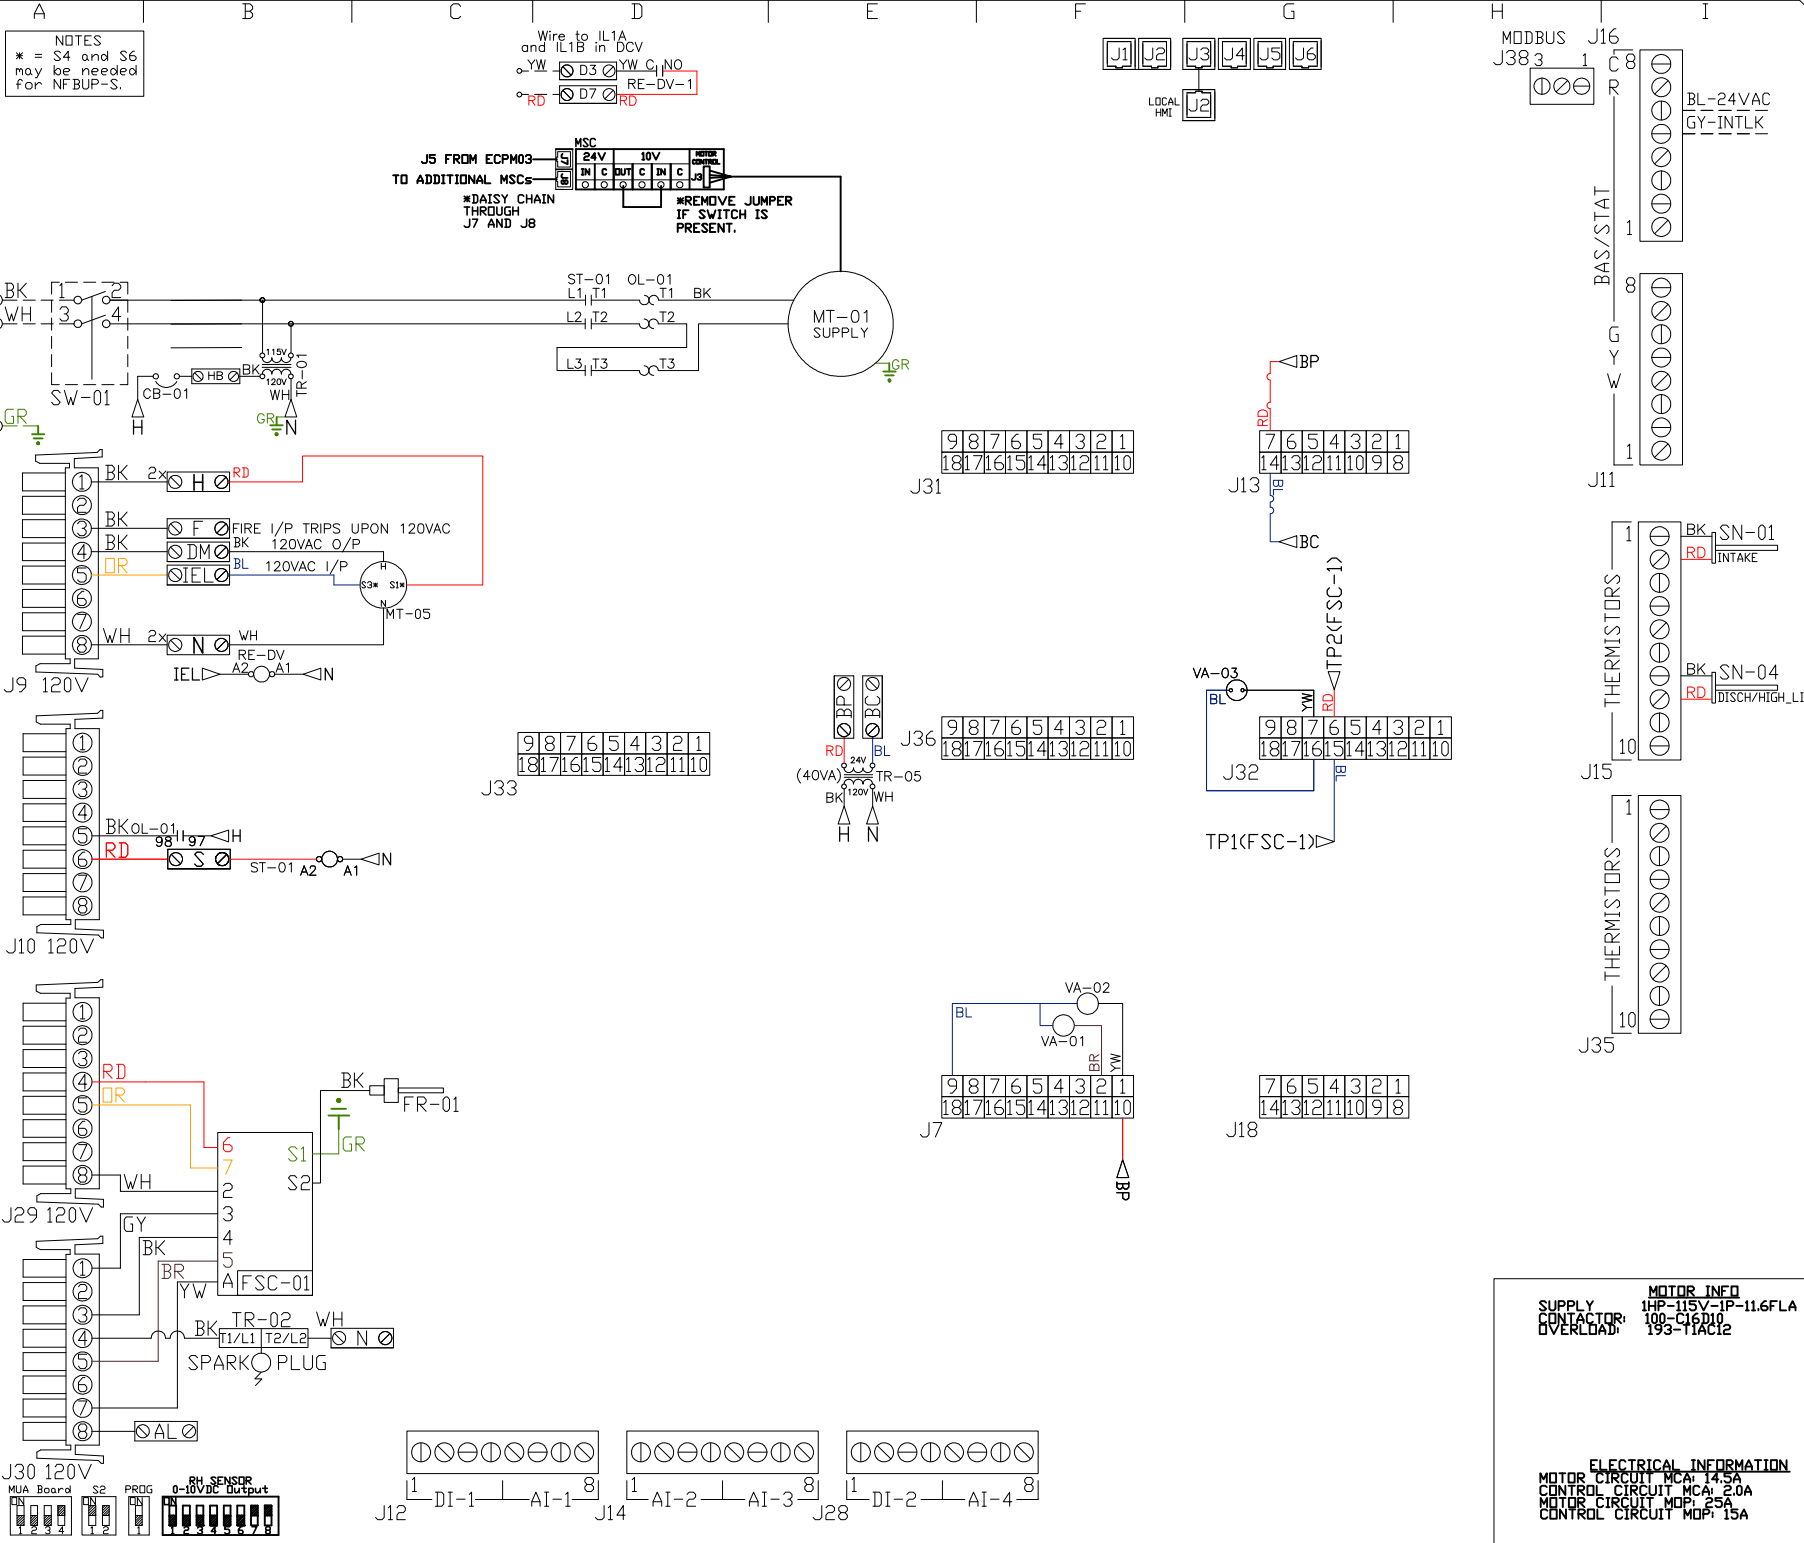

COMPONENT LIST	
LABEL	DESCRIPTION
CB-01	CIRCUIT_BREAKER
FR-01	EVD/ECH-ACU+S11-MP
FSC-01	FIREYE_FLAME_SAFETY
MT-01	SUPPLY_MOTOR
MT-05	INTAKE_DAMPER_MTR
DL-XX	MTR_OVERLOAD
SN-XX	TEMP SENSORS
ST-XX	MTR_STARTER
SW-01	DISCONNECT_SWITCH
TR-01	CTRL_TRANSFMR
TR-02	IGNITION_TRANSFMR
TR-05	BOARD_POWER_TRFMR
VA-01	PILOT_GAS_VALVE
VA-02	MAIN_GAS_VALVE
VA-03	MOD_GAS_VALVE

LEGEND	
---	FIELD WIRING
---	FACTORY WIRING
BK	BLACK
BR	BROWN
OR	ORANGE
WH	WHITE
DR/BL	DR/BL STRIPE
BL/RO	BL/RO STRIPE
RD/GR	RD/GR STRIPE
WH/BL	WH/BL STRIPE
YW	YELLOW
GY	GREY
PR	PURPLE
RD	RED
GR	GREEN

MOTOR INFO
 SUPPLY 1HP-115V-1P-11.6FLA
 CONTACTOR 100-CJ6D10
 OVERLOAD 193-11AC12

ELECTRICAL INFORMATION
 MOTOR CIRCUIT MCA: 14.5A
 CONTROL CIRCUIT MCA: 2.0A
 MOTOR CIRCUIT MDP: 25A
 CONTROL CIRCUIT MDP: 15A

JOB NAME
 8' Heated UC Le...

DRAWING TITLE
 Drawing Title

DESCRIPTION OF OPERATION
 MUA BOARD
 (DETAILS TO FOLLOW)

JOB NO 5910226
DATE AUTO
TYPE FACTORY
DATE 3/20/2023

DWG MW5910226-2

Installation Wiring

DRAWING NUMBER RP59102226-2

JOB

5910226 - 8' Heated UC Left** Hood Stock


SHIP DATE 3/20/2023

MODEL F1-D.500-15D

120 V 1 PH.

Gal-flex conduit (in unit)


Disconnect Switch

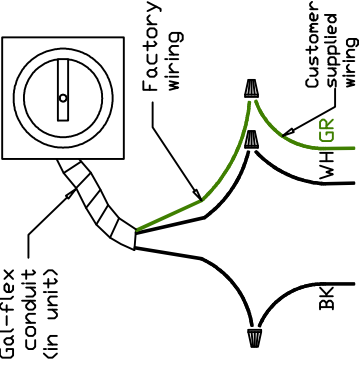

240 V 1 PH.

Gal-flex conduit (in unit)


Disconnect Switch

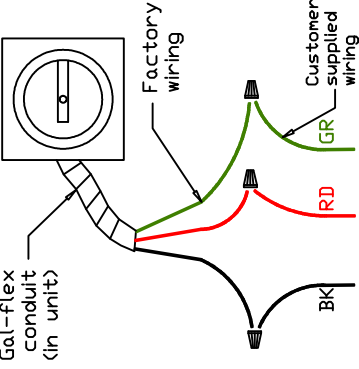

208/460/600 V 3 PH.


Gal-flex conduit (in unit)

Disconnect Switch

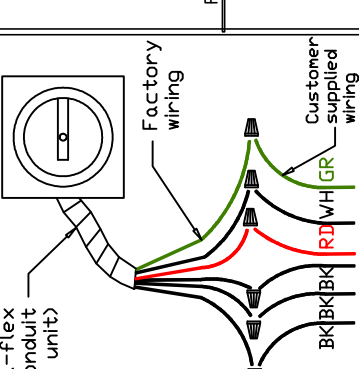

STANDING POWER RD & WH Wire (115V, 1 PHASE)

See above details.

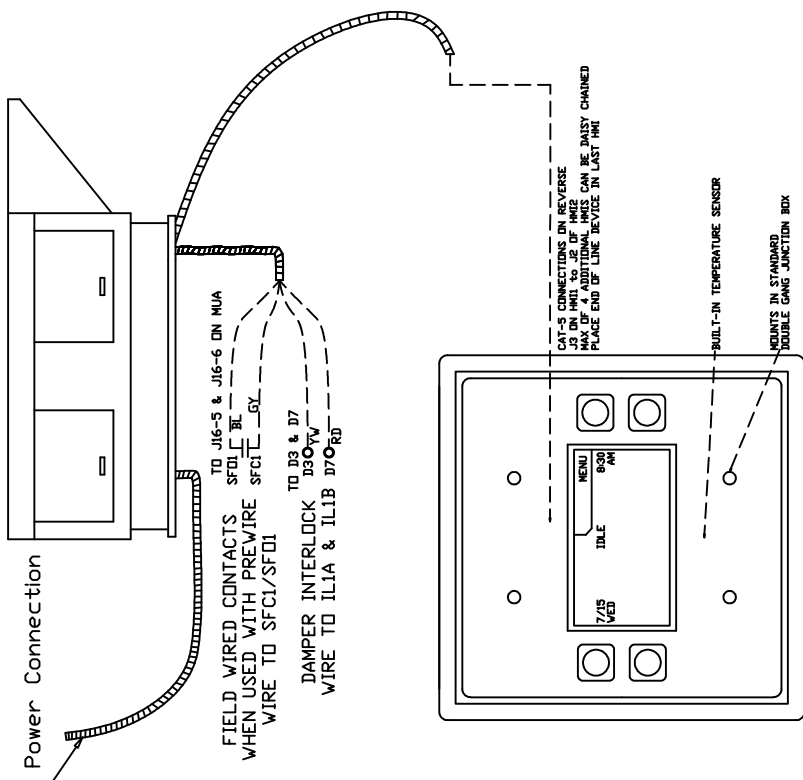

WIRE COLOR

BK	-	BLACK	YW	-	YELLOW
BL	-	BLUE	GR	-	GREEN
BR	-	BROWN	GY	-	GRAY
OR	-	ORANGE	PR	-	PURPLE
RD	-	RED	PK	-	PINK
WH	-	WHITE		-	

NOTES

Field Wired Switch

Installed Options

ELECTRICAL PACKAGE - JOB#5910226

NO	TAG	PACKAGE #	LOCATION	SWITCHES		OPTION	FANS CONTROLLED					
				LOCATION	QUANTITY		FAN TAG	TYPE	φ	HP	VOLT	FLA
1	8' Heated	SC-111110MA	UTILITY CABINET LEFT	FACE MOUNT RIGHT	1 LIGHT	SMART CONTROLS THERMOSTATIC CONTROL W/ RELAY ON/OFF WITH SUPPLY	8' Heated	EXHAUST	1	0.750	115	8.9
				SIDE OF HOOD								
				HOOD # 1								



FloAire

<i>JOB</i> 8' Heated UC Left** Hood Stock	
<i>LOCATION</i> ,	
<i>DATE</i> 3/20/2023	<i>JOB #</i> 5910226
<i>DWG #</i> 14	<i>DRAWN BY</i> courtneyh
<i>REV.</i>	<i>SCALE</i> 3/8" = 1'-0"

JOB NO
5910226

MODEL NUMBER
SC-11110MA

DRAWN BY
INSTALL

SCHEMATIC TYPE
INSTALL

DESCRIPTION OF OPERATION:

120V 1 Phase w/ control for 1 Exhaust Fan, 1 Supply Fan, Exhaust on In Fire, Lights out in Fire, Relay On/Off with Supply Fan, Fans On/Off Thermostatically Controlled. Room temperature sensor shipped loose for field installation.

JOB NAME
8' Heated UC Left Hood Stoc...


DATE
3/20/2023

DWG NO
ECP #1-1

BREAKER PANEL TO PRIMARY CONTROL PANEL


Responsibility: Electrician

BREAKER SIZE SHOWN IS THE MAXIMUM ALLOWED

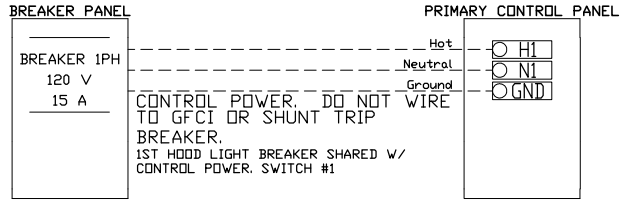


BREAKER PANEL TO FANS

Responsibility: Electrician

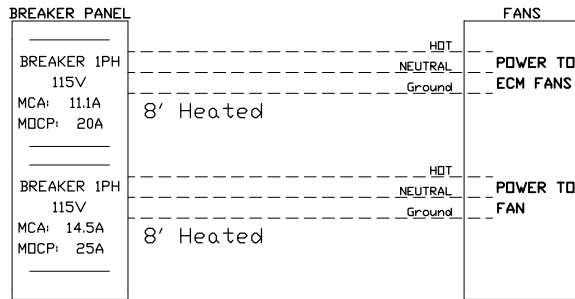



CONTROL PANEL TO FANS

Responsibility: Electrician





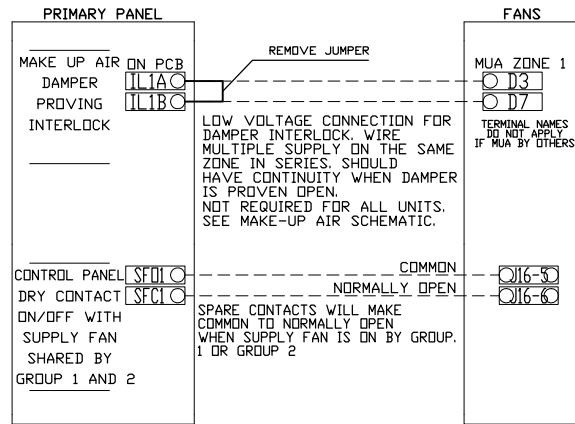


CONTROL PANEL TO ACCESSORY ITEMS



Responsibility: Electrician

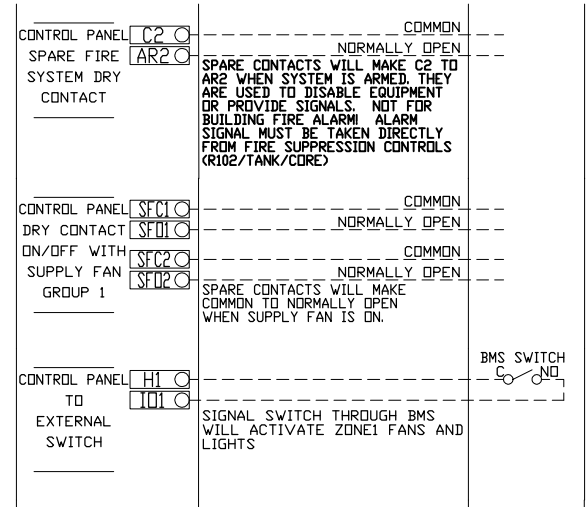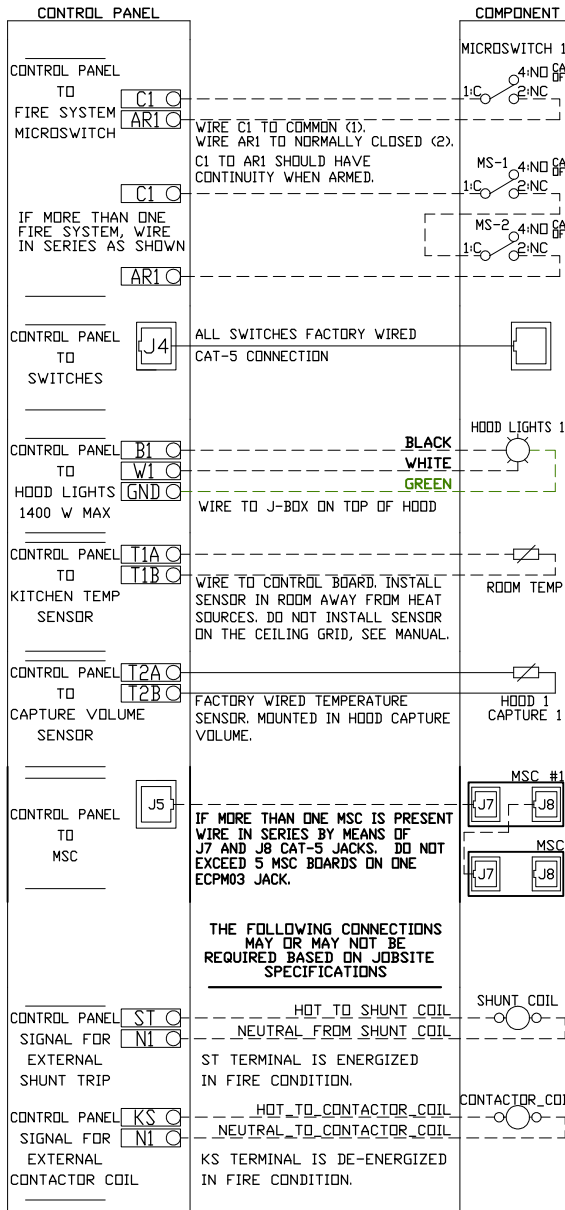

UNLESS SPECIFIED OTHERWISE, ALL FACTORY AC WIRING 16 AWG. ALL FACTORY DC WIRING 18 AWG.

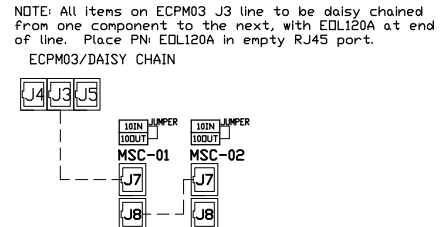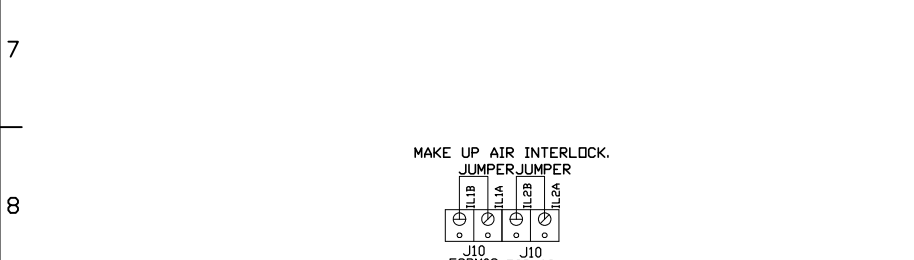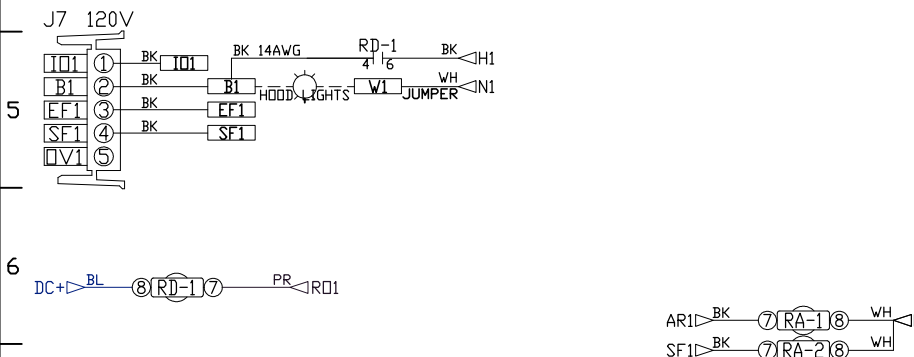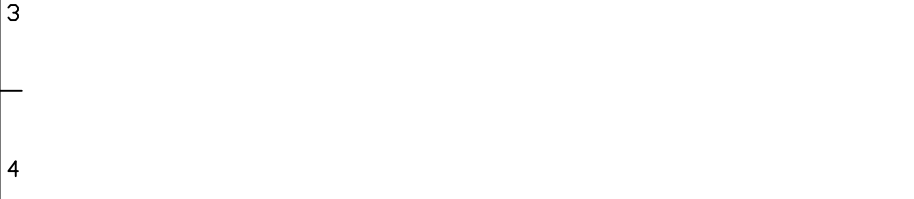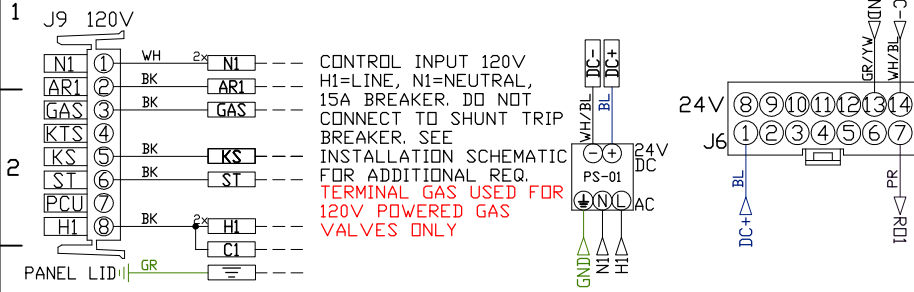

MOTOR POWER CIRCUIT

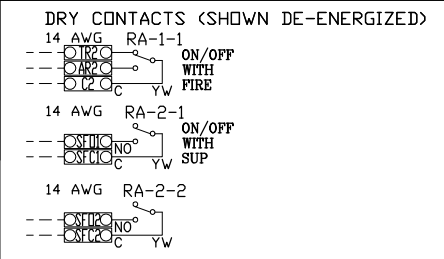

FACTORY WIRING SCHEMATIC CIRCUIT BOARDS

DCV Rev. 2.14.00
HMI Rev. 2.14.00

RA-x 120 VAC RELAY	RD-x 24 VDC RELAY
NO 4 3	NO 4 3
NC 2 1	NC 2 1
COIL 8 7	COIL 8 7
COM 6 5	COM 6 5

COMPONENT LIST

LABEL	DESCRIPTION
ST-X	Starter PN: varies
OL-X	Overload PN: varies
C-X	Contactor PN: varies
PS-1	Power Sup. 24VDC PN: MDP18-24A-1C
RA-x	120V Relay DPDT PN: 34.110.0184.0
RD-x	24VDC Light Relay PN: 34.110.0188.0
TS-x	Duct Thermostat PN: A/CP-PD-T4'-EXPL

LEGEND

---	FIELD WIRING
---	FACTORY WIRING
BK-	BLACK
BL-	BLUE
BR-	BROWN
DR-	ORANGE
WH-	WHITE
DR/BL-	DR/BL STRIPE
BL/RD-	BL/RD STRIPE
RD/GN-	RD/GN STRIPE
WH/BL-	WH/BL STRIPE
YW-	YELLOW
GY-	GREY
PR-	PURPLE
RD-	RED

JOB NAME
8' Heated UC Lef...

DRAWING TITLE
SC-111110MA

DESCRIPTION OF OPERATION
120V 1 Phase w/ control for 1 Exhaust Fan, 1 Supply Fan, Exhaust on in Fire, Lights out in Fire, Relay On/Off with Supply Fan, Fans On/Off Thermostatically Controlled. Room temperature sensor shipped loose for field installation.

JOB NO 5910226	DRAWN BY
TYPE FACTORY	DATE 3/20/2023
DWG NO ECP #1-2	