

C7021J/R, C7023J/R, C7031J, C7041J/R Averaging Sensors

C7021J, C7023J, C7031J, C7041J CABLE
C7021R, C7023R, C7041R RIGID COPPER

INSTALLATION INSTRUCTIONS

MOUNTING

The C7021J, C7023J, C7031J, and C7041J Wire/Thermistor Averaging Sensors and the C7021R, C7023R, and C7041R Rigid Copper Averaging Sensors can be mounted in a duct to sense average air temperature.

IMPORTANT

Select a spot for the sensor to expose it to average duct air temperature. Avoid locations where stratification can cause sensing errors.

INSTALLATION

When Installing this Product...

1. Read these instructions carefully. Failure to follow them could damage the product or cause a hazardous condition.
2. Check ratings given in instructions and on the product to ensure the product is suitable for your application.
3. Installer must be a trained, experienced service technician.
4. After installation is complete, check out product operation as provided in these instructions.

IMPORTANT

All wiring must agree with applicable codes, ordinances and regulations.

MODEL SELECTION

Models are available to meet most application needs.

- C7021 - 10K Ohms NTC Type II
- C7023 - 10K Ohms NTC Type III
- C7031 - 10K PTC
- C7041 - 20K Ohms NTC

For a complete list of available sensors see the Sensors Product Overview brochure (form number 63-9285).

Be sure to take advantage of the entire line of quality Honeywell C7021/C7023/C7031/C7041 Sensors



C7021K,
C7023K,
C7041K
Strap-on
Immersion



C7021F,
C7023F,
C7031F,
C7041F
Outdoor



C7021B/C,
C7023B/C,
C7041B/C
Duct



C7021R,
C7023R,
C7041R
Duct
Rigid
Copper
AVERAGING



C7021P,
C7023P,
C7041P
Button
Probe



C7021J,
C7023J,
C7031J,
C7041J
Duct Cable



C7021J, C7023J, C7031J, C7041J Mounting

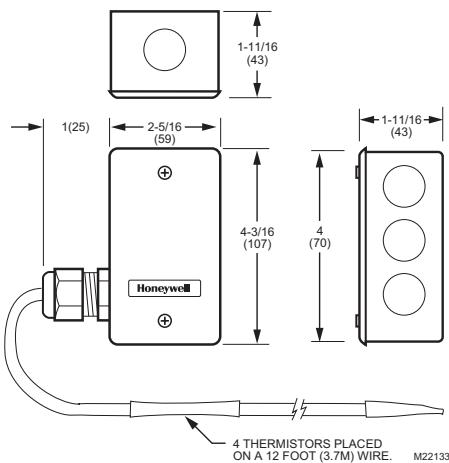


Fig. 1. C7021J, C7023J, C7031J, C7041J dimensions in in. (mm).

1. Install two supports inside the duct to hold the averaging element.
2. Cut a 7/8 in. (22 mm) hole in the side of the duct to insert the averaging element.
3. Fasten the terminal box to the outside of the duct and thread the element through the hole and into the duct.
4. Use plastic wire ties to fasten the element to the supports. Seal the hole around the element with a rubber grommet.
5. Secure the end of the element to the duct on the support to prevent continuous flexing or abrasion.

IMPORTANT

To ensure that the C7021J/C7023J/C7031J/C7041J senses average duct temperature, position the temperature elements approximately as shown in Fig. 2. Do not allow the elements to touch or be close to the duct sides.

NOTE: When the sensor is used as a deck sensor in a multizone system, be sure to space the elements equally in the duct midstream as shown in Fig. 3.

Install one C7021J/C7023J/C7031J/C7041J just upstream from the cold deck zone dampers and the other C7021J/C7023J/C7031J/C7041J upstream from the hot deck zone dampers. Position the thermistors to sense the average deck temperature.

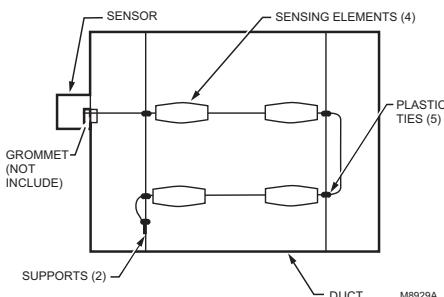


Fig. 2. Duct cross section showing method of installing C7021J, C7023J, C7031J, C7041J Averaging Electronic Sensor.


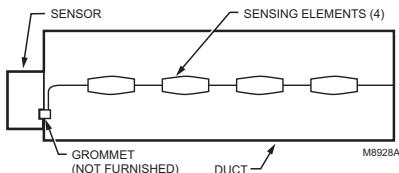


Fig. 3. Duct cross section showing method of installing C7021J, C7023J/C7031J/C7041J in a multizone system.

C7021R, C7023R, C7041R Mounting

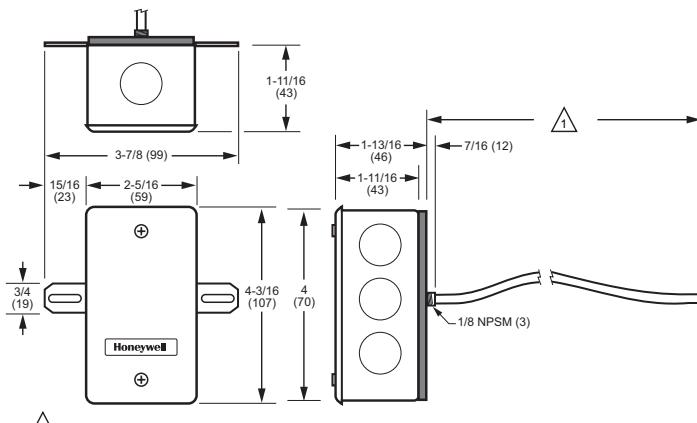

⚠ DEPENDING ON THE MODEL, THE ELEMENT LENGTH IS EITHER 12 FT (366 CM) OR 24 FT (732 CM).

M22818

Fig. 4. C7021R, C7023R, C7041R dimensions in in. (mm).


1. Install two supports inside the duct to hold the averaging element.
2. Cut a 7/8 in. (22 mm) hole in the side of the duct.
3. Insert the averaging element into the duct through the hole.
4. Fasten the terminal box to the outside of the duct and thread the element through the hole and into the duct.
5. Use plastic wire ties to fasten the element to the supports. Seal the hole around the element with a rubber grommet.
6. Secure the end of the element to the duct on the support to prevent continuous flexing or abrasion.

IMPORTANT

To ensure that the C7021R, C7023R, C7041R senses average duct temperature, position the temperature elements approximately as shown in Fig. 5. Do not allow the elements to touch or be close to the duct sides.

NOTE: When the sensor is used as a deck sensor in a multizone system, be sure to space the elements evenly in the duct midstream as shown in Fig. 6.


Install one C7021R, C7023R, C7041R just upstream from the cold deck zone dampers and the other C7021R, C7023R, C7041R upstream from the hot deck zone dampers. Position the thermistors to sense the average deck temperature.

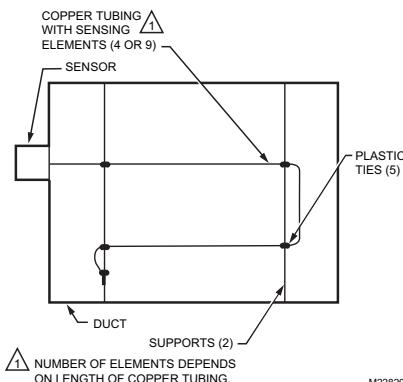

⚠ NUMBER OF ELEMENTS DEPENDS ON LENGTH OF COPPER TUBING.

M22820

Fig. 5. Duct cross section showing method of installing C7021R, C7023R, C7041R Averaging Electronic Sensor.

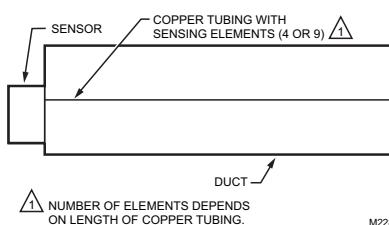

⚠ NUMBER OF ELEMENTS DEPENDS ON LENGTH OF COPPER TUBING.

M22819

Fig. 6. Duct cross section showing method of installing C7021R, C7023R, C7041R in a multizone system.

Automation and Control Solutions
Honeywell International Inc.
1985 Douglas Drive North
Golden Valley, MN 55422
yourhome.honeywell.com

Honeywell

© U.S. Registered Trademark
© 2011 Honeywell International Inc.
62-0219-01 M.S. Rev. 06-11
Printed in the U.S.A.