


## Application

VB-7273 series single seat, stem down to close, two-way valves control water from 20 to 400°F (-7 to 204°C) or steam to 400°F (204°C) max. in heating or air conditioning systems. These valves have stainless steel seat and plug. They are used for two-position or proportional control applications. Valve assemblies require an actuator and a valve linkage that must be purchased separately.



**Danger:** Do not use for combustible gas applications. The VB-7273 series valve packings are not rated for combustible gas applications, and if used in these applications, gas leaks and explosions could result.

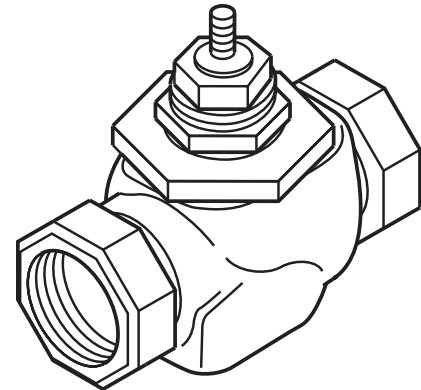

## Features

- Valve sizes 1/2" to 2"
- 250 psig pressure rating per ANSI Standards (B16.15-1985)
- Spring-loaded TFE packing
- American Standard Taper Pipe Thread (NPT) connections
- Stainless steel seat and plug

## Applicable Literature

- TAC Valve Products Catalog, F-27384
- TAC Cross-Reference Guide, F-23638
- TAC Reference Manual, F-21683
- TAC Application Manual, F-21335
- Control Valve Sizing, F-13755
- Valve Selection Chart for Steam, F-11366
- Valve Selection Chart for Water, F-11080
- EN-205 Water System Guidelines, F-26080

# SPECIFICATIONS

**Table-1 Specifications/Models.**

Specifications		Valve Body Series VB-7273-0-4-P	
<b>Service</b>		Hot Water and Steam	
<b>Flow Characteristics (Figure-1)</b>		Equal Percentage	
<b>Action</b>		Stem Up Open	
<b>Sizes</b>		1/2" to 2"	
<b>Type of End Fitting</b>		NPT	
<b>Valve Materials</b>	<b>Body</b>	Bronze	
	<b>Seat</b>	Stainless Steel	
	<b>Stem</b>	Stainless Steel	
	<b>Plug</b>	Stainless Steel	
	<b>Packing</b>	Spring-loaded TFE	
	<b>Disc</b>	None	
<b>ANSI Pressure Class (Figure-2)</b>		250 (up to 400 psig below 150°F)	
<b>Maximum Inlet Pressure, Steam</b>		150 psig (1034 kPa)	
<b>Allowable Control Media Temperature</b>		20 to 400°F (-7 to 204°C)	
<b>Allowable Differential Pressure for Water<sup>a</sup></b>		35 psi (241 kPa) Max. for Normal Life (refer to "Cavitation Limitations on Valve Pressure Drop" on page 8)	
<b>Allowable Differential Pressure for Steam<sup>a</sup></b>		50 psi (345 kPa)	
<b>Valve Size</b>	<b>C<sub>v</sub> Rating</b>	<b>k<sub>vs</sub> Rating<sup>b</sup></b>	<b>Complete Valve Body Part Number</b>
1/2"	0.4	0.3	<b>VB-7273-0-4-1</b>
	1.3	1.1	<b>VB-7273-0-4-2</b>
	2.2	1.9	<b>VB-7273-0-4-3</b>
	4.4	3.8	<b>VB-7273-0-4-4</b>
3/4"	5.5	4.8	<b>VB-7273-0-4-5</b>
	7.5	6.5	<b>VB-7273-0-4-6</b>
1"	10	8.7	<b>VB-7273-0-4-7</b>
	12	10	<b>VB-7273-0-4-8</b>
1-1/4"	20	17	<b>VB-7273-0-4-9</b>
1-1/2"	28	24	<b>VB-7273-0-4-10</b>
2"	40	35	<b>VB-7273-0-4-11</b>

<sup>a</sup> Maximum recommended differential pressure in open position. Do not exceed recommended differential pressure (pressure drop) or integrity of parts may be affected. Exceeding maximum recommended differential pressure voids product warranty.

<sup>b</sup>  $k_{vs} = m^3/h$  ( $\Delta P = 100$  kPa)       $C_v = k_{vs} \times 1.156$

## Close-off Pressure Rating

The close-off pressure rating is dependent on the size of the valve, valve linkage, and actuator. Consult the **TAC Valve Products Catalog, F-25683**, for close-off ratings.

## Normal Position of Valve Assembly

For a valve assembly (valve, linkage, and actuator) to have a normal (spring return) position, the actuator must be of the spring return type. See Table-2 for normal position of valve assemblies.

**Table-2 Required Compatible Actuators/Linkages.**

Actuator Series	Required Valve Linkage	Normal Position
MA-318, MA-418, MA-419	AV-391	N.O. or N.C. <sup>a</sup>
MA-5210, MA-5211, MA-5213	AV-7600 <sup>b</sup>	Normally Open
MC-351, MC-431, MC-4311, MC5-4311	AV-393	None
MF-5413, MF-5513	AV-7600 <sup>b</sup>	Normally Open
MF-22203, MF-22303, MF-22323	Included w/Actuator	None
MF-63103, MF-63123		
MK-2690	AV-7400	Normally Open
MK-4601, MK-4611, MK-4621	AV-401	
MK-6601, MK-6611, MK-6621	—	
MM-400, MMR-400	AV-630	None
MM-500, MMR-500		N.O. or N.C. <sup>a</sup>
MP-361, MP-465, MP5-4651	AV-391	Normally Closed
MP-371, MP-475, MP5-4751		Normally Open
MP-381, MP-382, MP-485, MP-486, MP-4851, MP5-4851	AV-393	None
MP-5210, MP-5211, MP-5213	AV-7600 <sup>b</sup>	Normally Open
MP-5410, MP-5411, MP-5413	AV-7600 & AV-601	
MP-5513		
MPR-5610, MPR-5611, MPR-5613		
MPR-5713		
MS-22353	Included w/Actuator	None

<sup>a</sup> Normal position dependent upon linkage installation. See linkage General Instructions.

<sup>b</sup> High ambient temperatures with high media temperatures in the valve may require the use of AV-601 in addition to AV-7600. See General Instructions for AV-7600 (F-26235) and AV-601 (F-19069) for details.

## Flow Characteristics

All valves have modified equal percentage flow characteristics. That is, for equal increments of valve stem stroke, the change in flow rate with respect to valve stroke may be expressed as a constant percent of the flow rate at the time of the change. The change of flow rate with respect to valve stroke is relatively small when the valve plug is near the valve seat and relatively high when the valve plug is nearly wide open. See Figure-1 for typical modified equal percentage flow characteristics of VB-7273 series valve bodies.

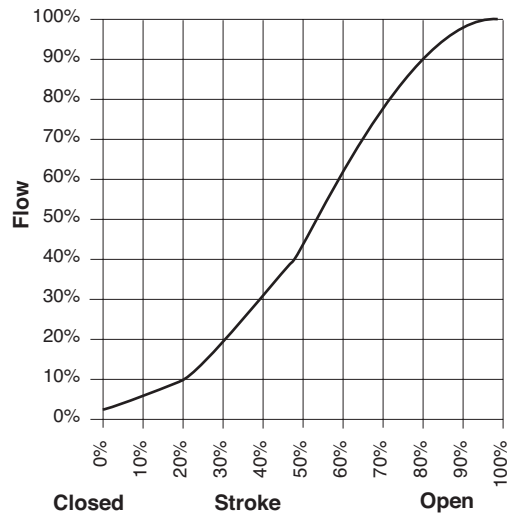


Figure-1 Typical Modified Equal Percentage Flow Characteristics.

### Rangeability

Rangeability is the ratio of rated flow to the minimum controllable flow through a valve. Table-3 lists the rangeability for VB-7273 series valves.

Table-3 Rangeability.

Valve Body Part Number	Nominal Rangeability	Valve Body Part Number	Nominal Rangeability
VB-7273-0-4-1	5:1	VB-7273-0-4-7	60:1
VB-7273-0-4-2	15:1	VB-7273-0-4-8	75:1
VB-7273-0-4-3	25:1	VB-7273-0-4-9	75:1
VB-7273-0-4-4	40:1	VB-7273-0-4-10	75:1
VB-7273-0-4-5	50:1	VB-7273-0-4-11	75:1
VB-7273-0-4-6	60:1		

### Temperature/Pressure Ratings

See Figure-2 for temperature and pressure ratings. Consult the appropriate valve linkage general instruction sheet for the effect of valve body ambient temperatures on specific actuators. Ratings conform with published values and disclaimer.

#### VB-7273-0-4-P (Screwed Cast Bronze Body)

*Standards:* Pressure to ANSI B16.15 Class 250 with 400 psig up to 150°F

*Materials:* Bronze, ASTM B584

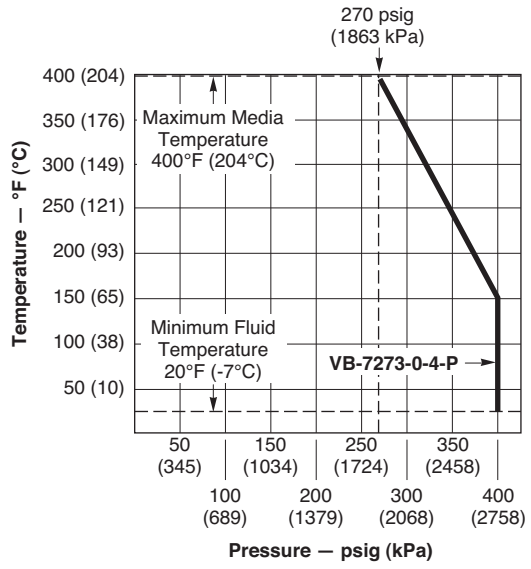


Figure-2 Temperature and Pressure Ratings for VB-7273 Series Valve Bodies.

# VALVE SIZING AND SELECTION

## Water

### Two-position

Two-position control valves are normally selected “line size” to keep pressure drop at a minimum. If it is desirable to reduce the valve below line size, then 10% of “available pressure” (that is, the pump pressure differential available between supply and return mains with design flow at the valve location) is normally used to select the valve.

### Proportional

Proportional control valves are usually selected to take a pressure drop equal to at least 50% of the “available pressure.” As “available pressure” is often difficult to calculate, the normal procedure is to select the valve using a pressure drop at least equal to the drop in the coil or other load being controlled (except where small booster pumps are used) with a minimum recommended pressure drop of 5 psi (34 kPa). When the design temperature drop is less than 60°F (33°C) for conventional heating systems, higher pressure drops across the valve are needed for good results (Table-4).

**Table-4 Conventional Heating System.**

Design Temperature Load Drop °F (°C)	Recommended Pressure Drop <sup>a</sup> (% of Available Pressure)	Multiplier on Load Drop
60 (33) or More	50%	1 x Load Drop
40 (22)	66%	2 x Load Drop
20 (11)	75%	3 x Load Drop

<sup>a</sup> Recommended minimum pressure drop = 5 psi (34 kPa).

**Secondary Circuits with Small Booster Pumps:** 50% of available pressure difference (equal to the drop through load, or 50% of booster pump head).

### Water Capacity

See Table-5 for water capacity of VB-7273 series valves.

**Table-5 Water Capacity in Gallons Per Minute for VB-7273 Series.**

Valve Body Part Number	C <sub>v</sub> Rating	Differential Pressure (ΔP in psi)												
		1	2	3	4	5	6	7	8	9	10	15	20	35
VB-7273-0-4-1	0.4	0.40	0.57	0.69	0.80	0.89	0.98	1.06	1.13	1.20	1.26	1.55	1.79	2.37
VB-7273-0-4-2	1.3	1.30	1.84	2.3	2.6	2.9	3.2	3.4	3.7	3.9	4.1	5.0	5.8	7.7
VB-7273-0-4-3	2.2	2.2	3.1	3.8	4.4	4.9	5.4	5.8	6.2	6.6	7.0	8.5	9.8	13
VB-7273-0-4-4	4.4	4.4	6.2	7.6	8.8	9.8	11	12	12	13	14	17	20	26
VB-7273-0-4-5	5.5	5.5	7.8	9.5	11	12	13	15	16	17	17	21	25	33
VB-7273-0-4-6	7.5	7.5	11	13	15	17	18	20	21	23	24	29	34	44
VB-7273-0-4-7	10	10	14	17	20	22	24	26	28	30	32	39	45	59
VB-7273-0-4-8	12	12	17	21	24	27	29	32	34	36	38	47	54	71
VB-7273-0-4-9	20	20	28	35	40	45	49	53	57	60	63	77	89	118
VB-7273-0-4-10	28	28	40	49	56	63	69	74	79	84	89	108	125	166
VB-7273-0-4-11	40	40	57	69	80	89	98	106	113	120	126	155	179	237

### C<sub>v</sub> Equation

$$C_v = \frac{\text{GPM}}{\sqrt{\Delta P}} \quad \Delta P = \left( \frac{\text{GPM}}{C_v} \right)^2 \quad \text{GPM} = C_v \sqrt{\Delta P}$$

Where:

C<sub>v</sub> = Coefficient of flow

GPM = U.S. gallons per minute (60°F, 15.6°C)

ΔP = Differential pressure in psi (pressure drop)

## Steam

### Two-position

Two-position zone valves and direct radiation valves are normally sized using a minimum of 10% of inlet pressure (psig).

### Proportional

Proportional control valves are normally sized using:

- For low pressure (15 psig or less), use  $\Delta P$  of 80% of gauge inlet pressure.
- For steam pressures greater than 15 psig, use  $\Delta P$  of 42% of absolute (gauge plus 14.7) inlet pressure.
- When the  $C_v$  required is between two valve sizes, select the larger size. Do not size steam valves using a pressure drop greater than 42% of the absolute inlet pressure.

### Steam Capacity

See Table-6 for steam capacity of VB-7273 series valves.

**Table-6 Steam Capacity in Pounds Per Hour for VB-7273 Series.**

Valve Body Part Number	$C_v$ Rating	Differential Pressure ( $\Delta P$ in psi) <sup>a</sup>											
		2 psig Inlet		5 psig Inlet		10 psig Inlet		15 psig Inlet		20 psig Inlet		25 psig Inlet	
		0.2	1.6	0.5	4	1	8	1.5	12	2	14	2.5	16
VB-7273-0-4-1	0.4	2.2	5.9	3.7	9.5	5.8	14	7.8	18	9.7	20	12	23
VB-7273-0-4-2	1.3	7.1	19	12	31	19	45	25	57	32	66	38	76
VB-7273-0-4-3	2.2	12	32	20	52	32	76	43	96	53	112	64	129
VB-7273-0-4-4	4.4	24	65	41	105	64	153	86	192	107	225	127	257
VB-7273-0-4-5	5.5	30	81	51	131	80	191	107	240	133	281	159	321
VB-7273-0-4-6	7.5	41	111	70	178	110	260	146	328	182	383	217	438
VB-7273-0-4-7	10	55	147	93	238	146	347	195	437	243	511	289	584
VB-7273-0-4-8	12	65	177	112	285	175	416	234	525	291	613	347	701
VB-7273-0-4-9	20	109	295	186	475	292	694	390	874	485	1021	579	1168
VB-7273-0-4-10	28	153	413	260	666	409	971	546	1224	679	1430	810	1636
VB-7273-0-4-11	40	218	590	372	951	584	1387	780	1749	970	2043	1157	2337

Valve Body Part Number	$C_v$ Rating	Differential Pressure ( $\Delta P$ in psi) <sup>a</sup>											
		30 psig Inlet		35 psig Inlet		40 psig Inlet		50 psig Inlet		75 psig Inlet		100 psig Inlet	
		3	18	3.5	20	4	22	5	27	7.5	37	10	48
VB-7273-0-4-1	0.4	15	31	16	32	17	32	21	38	30	53	39	68
VB-7273-0-4-2	1.3	49	100	52	103	56	105	67	124	97	172	126	221
VB-7273-0-4-3	2.2	82	170	88	174	94	177	114	211	164	291	214	373
VB-7273-0-4-4	4.4	164	339	177	348	188	354	228	421	328	583	427	747
VB-7273-0-4-5	5.5	205	424	221	435	235	443	285	526	410	729	534	934
VB-7273-0-4-6	7.5	280	578	301	593	320	603	389	718	559	994	728	1273
VB-7273-0-4-7	10	374	771	402	790	427	805	518	957	745	1325	971	1697
VB-7273-0-4-8	12	403	789	458	877	513	966	622	1149	894	1590	1165	2037
VB-7273-0-4-9	20	747	1542	803	1581	854	1609	1037	1914	1490	2649	1941	3395
VB-7273-0-4-10	28	939	1841	1068	2047	1196	2253	1451	2680	2086	3709	2718	4753
VB-7273-0-4-11	40	1494	3084	1606	3161	1709	3219	2073	3829	2980	5299	3883	6790

<sup>a</sup> Values are for saturated steam ( $K = 1$ ). Left column under each inlet pressure is for two-position control, and right column is for proportional control.

### C<sub>v</sub> Equation

$$C_v = \frac{QK}{3\sqrt{\Delta P \cdot P_2}} \quad Q = \frac{3C_v\sqrt{\Delta P \cdot P_2}}{K}$$

Where:

C<sub>v</sub> = Coefficient of flow

Q = Lbs. per hour of steam

ΔP = Differential pressure in psi (pressure drop)

P<sub>2</sub> = Outlet pressure in psia (absolute) (P<sub>2</sub> = Inlet pressure + 14.7 – ΔP)

K = 1 + (0.0007 x °F superheat) (K = 1 for saturated steam)

## Cavitation Limitations on Valve Pressure Drop

A valve selected with too high a pressure drop can cause erosion of discs and/or wire drawing of the seat. In addition, cavitation can cause noise, damage to the valve trim (and possibly the body), and choke the flow through the valve.

Do not exceed the maximum differential pressure (pressure drop) for the valve selected.

The following formula can be used on higher temperature water systems, where cavitation could be a problem, to estimate the maximum allowable pressure drop across the valve:

$$P_m = 0.5 (P_1 - P_v)$$

Where:

P<sub>m</sub> = Maximum allowable pressure drop (psi)

P<sub>1</sub> = Absolute inlet pressure (psia)

P<sub>v</sub> = Absolute vapor pressure (psia) (refer to Table-6 or Table-7)

---

*Note:* Add 14.7 psi to gauge supply pressure to obtain absolute pressure value.

---

For example, if a valve is controlling 200°F water at an inlet pressure of 18 psig, the maximum pressure drop allowable would be:

$$P_m = 0.5 [(18 + 14.7) - 11.53] = 10.6 \text{ psi}$$

(Vapor pressure of 200°F water is 11.53 psia.)

If the pressure drop for this valve is less than 10.6 psi, cavitation should not be a problem.

Systems where cavitation is shown to be a problem can sometimes be redesigned to provide lower inlet velocities.

**Table-7 Vapor Pressure of Water Table.**

Water Temp. (°F)	Vapor Pressure (psia)	Water Temp. (°F)	Vapor Pressure (psia)	Water Temp. (°F)	Vapor Pressure (psia)	Water Temp. (°F)	Vapor Pressure (psia)
40	0.12	90	0.70	140	2.89	190	9.34
50	0.18	100	0.95	150	3.72	200	11.53
60	0.26	110	1.28	160	4.74	210	14.12
70	0.36	120	1.69	170	5.99	220	17.19
80	0.51	130	2.22	180	7.51	230	20.78

## Additional Valve Sizing Information

For additional valve sizing information, see:

- CA-28 Control Valve Sizing, F-13755
- Valve Selection Chart Water, F-11080
- Valve Selection Chart Steam, F-11366
- Valve Sizing Slide Rule, TOOL-150



# INSTALLATION

## Inspection

Inspect the package for damage. If damaged, notify the appropriate carrier immediately. If undamaged, open the package and inspect the device for obvious damage. Return damaged products.

## Requirements

- Tools (not provided): Pipe wrenches
- Training: Installer must be a qualified, experienced technician
- Appropriate accessories

---

**Caution:**

- Install the valve with the flow in the direction of the flow arrow ("A" port is the inlet and "AB" port is the outlet).
  - Do not exceed the ratings of the device.
  - Avoid locations where excessive moisture, corrosive fumes, or vibration are present.
- 

## Mounting

1. The valve should be mounted in a weather-protected area in a location that is within the ambient limits of the actuator. When selecting a location, allow sufficient room for valve linkage, actuator, and other accessories and for service of the product.
2. The preferred mounting position for the valve is with the valve stem vertical above the valve body. Avoid mounting the valve so that the valve stem is below horizontal.
3. On steam applications where the ambient temperature approaches the limit of the actuator, the valve stem should be mounted 45° from vertical.
4. The VB-7273-0-4 series screwed valve bodies conform to American Standard Taper Pipe Threads (NPT). The valves must be piped with the "A" port as the inlet and the "AB" port as the outlet.
5. Apply pipe dope sparingly to all but the last two threads of a properly threaded, reamed, and cleaned pipe. Make sure that pipe chips, scale, etc. do not get into the pipe since this material may lodge in the valve seat and prevent proper closing and opening of the valve.
6. Start the joint by hand screwing the pipe into the valve. If the thread engagement feels "right," turn the pipe by hand as far as it will go.
7. Use a pipe wrench to fully tighten the valve to the pipe. Do not over tighten or strip threads. See Table-8 and Figure-3 for the normal engagement length of the threads. Figure-4 shows a means of tightening the pipe so that the valve is not twisted or crushed.

**Table-8 Normal Thread Engagement Between Male Pipe Thread and Valve Body.**

Valve Size Inches (NPT)	Normal Engagement	Valve Size Inches (NPT)	Normal Engagement
1/2"	1/2"	1-1/4"	11/16"
3/4"	9/16"	1-1/2"	11/16"
1"	11/16"	2"	3/4"

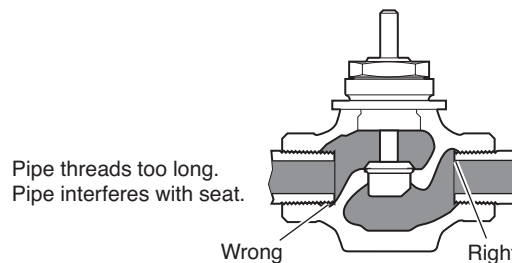


Figure-3 Normal Thread Engagement.

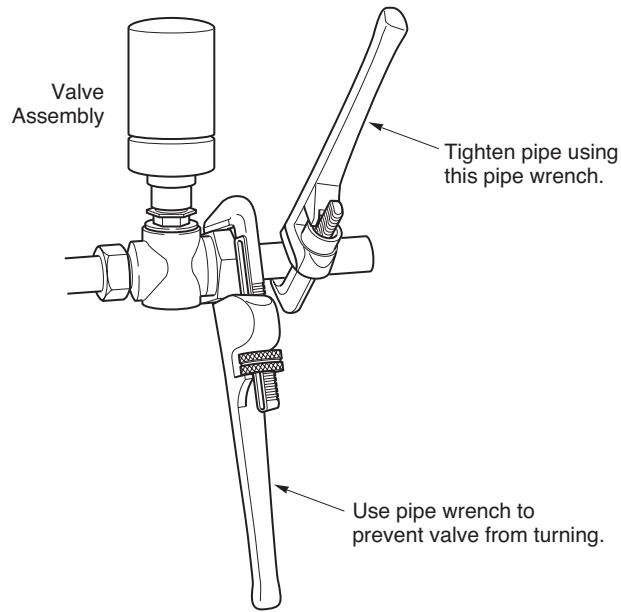


Figure-4 Installation of Screwed End Valves.

## CHECKOUT

1. Make sure the valve stem operates smoothly before installing the valve linkage and the actuator.
2. If the stem does not operate smoothly, it may indicate that the valve was twisted or crushed during installation or that the stem was bent by rough handling. These conditions may require that the valve be replaced.
3. After the piping is under pressure, check the valve body and the connections for leaks.
4. After the valve linkage and the actuator are installed, check their operation.

## MAINTENANCE & FIELD REPAIR

Regular maintenance of the total system is recommended to assure sustained performance. See Table-9 for maintenance kit part numbers.

Table-9 Maintenance Kits for VB-7273 Valves.

Valve Body Part Number	Replacement Packing Assembly	Packing Wrench	Seat Replacement Tool <sup>a</sup>		Stainless Steel Seat Part Number	Valve Repair Kit <sup>b</sup>
			Part Number	Size in inches (mm)		
VB-7273-0-4-1	YBA-622-1	TOOL-20-1	TOOL-7253-101-0-04	1/2 (15)	NYBA-7253-101-0-4	RYP-727-1
VB-7273-0-4-2						RYP-727-2
VB-7273-0-4-3						RYP-727-3
VB-7273-0-4-4						RYP-727-4
VB-7273-0-4-5			TOOL-7253-101-0-06	3/4 (20)	NYBA-7253-101-0-6	RYP-727-5
VB-7273-0-4-6						RYP-727-6
VB-7273-0-4-7						RYP-727-7
VB-7273-0-4-8			TOOL-7253-101-0-08	1 (25)	NYBA-7253-101-0-8	RYP-727-8
VB-7273-0-4-9						RYP-727-9
VB-7273-0-4-10						RYP-727-10
VB-7273-0-4-11			TOOL-7253-101-0-10	1-1/2 (38)	NYBA-7253-101-0-10	RYP-727-10
	TOOL-7253-101-0-11	2 (50)	NYBA-7253-101-0-11	RYP-727-11		

<sup>a</sup> All six tool sizes are included in package. Refer to **TOOL-7253 Series Stainless Steel Trim Valve Seat Replacement Tool General Instructions, F-26387**, for details. Stainless steel valve replacement seats are sold separately.

<sup>b</sup> Kit includes replacement packing and stem & plug assembly.

## Water System Maintenance

All heating and cooling systems are susceptible to valve and system problems caused by improper water treatment and system storage procedures. These guidelines are provided to help avoid valve and water system problems resulting from improperly treated water or storage procedures in cooling and hot water systems, and to obtain maximum life from TAC valves.

Durability of valve stems and packings is dependent on maintaining non-damaging water conditions. Inadequate water treatment or filtration, not in accordance with chemical supplier/ASHRAE handbook recommendations, can result in corrosion, scale, and abrasive particle formation. Scale and particulates can result in stem and packing scratches and can adversely affect packing life and other parts of the hydronic system.

To maintain non-damaging conditions, follow these guidelines:

- Clean the system prior to start up. Use a nitrite or molybdate-based treatment program.
- Use filtration equipment where needed.
- Properly store off-line systems and monitor water treatment results using corrosion test coupons.
- Follow the advice of a water treatment professional.
- Consult **EN-205, Water System Guidelines Engineering Information, F-26080**, for further details.

## DIMENSIONAL DATA

Table-10 Dimensions for VB-7273 Series Valves (Figure-5).

Part Number	Valve Size	Dimensions in Inches (mm)				
		A	B	C	D (Stem Down)	E <sup>a</sup> (Stroke)
VB-7273-0-4-1 VB-7273-0-4-2 VB-7273-0-4-3 VB-7273-0-4-4	1/2"	3-1/16 (78)	1-1/4 (32)	1-11/16 (43)	3/4 (19)	7/16 (11)
VB-7273-0-4-5 VB-7273-0-4-6	3/4"					
VB-7273-0-4-7 VB-7273-0-4-8	1"	4-5/8 (118)	1-1/8 (29)	2-3/8 (60)		
VB-7273-0-4-9	1-1/4"		1-3/8 (35)			
VB-7273-0-4-10	1-1/2"	5-3/8 (137)	1-1/2 (38)	2-7/16 (57)		
VB-7273-0-4-11	2"	6-1/8 (156)	1-9/16 (40)	2-3/4 (70)		

<sup>a</sup> Add up to 1/16 inch (1.6 mm) for disc seating and compression.

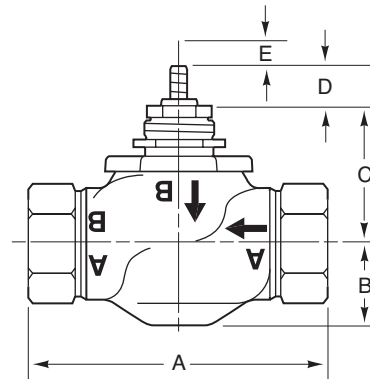


Figure-5 Typical of VB-7273-0-4-P Valve Bodies.

---

Copyright 2008, TAC  
All brand names, trademarks and registered  
trademarks are the property of their respective  
owners. Information contained within this  
document is subject to change without notice.

F-24390-2

**TAC**  
1354 Clifford Avenue  
P.O. Box 2940  
Loves Park, IL 61132-2940  
[www.tac.com](http://www.tac.com)

**t.a.c.**   
**by Schneider Electric**